



A Narrative Approach to Five Phase Transmission System

K. P. Prasad Rao¹ | T. Hari Hara Kumar² | I. Raghunadh³

¹Department of Electrical & Electronics Engineering, K L University, Guntur, Andhra Pradesh, INDIA

²Department of Electrical & Electronics Engineering, K L University, Guntur, Andhra Pradesh, INDIA

³Department of Electrical & Electronics Engineering, K L University, Guntur, Andhra Pradesh, INDIA

ABSTRACT

The power demand is increasing day to day and is becoming prime requirement. High Phase Order (HPO) transmission system is being considered a viable alternative to meet the demand by increasing the power transmission capability. Mainly the research of HPO systems is going on six and twelve phase transmission systems since they are multiples of three. But there is no difference in magnitude between the line voltage and phase voltage. This paper takes the instigation regarding Five Phase transmission system and results are compared with 132 kV three phase system. This paper investigates the weight of the conductor, sag of the conductor and spacing between the conductors, Inductance and capacitance calculations required in 132 kV Five Phase transmission system. Also, shows the line model of Five Phase transmission system. So, industrial loads can be driven with Five Phase supply as a ripple free torque and efficiency will be increased effectively.

KEYWORDS: Higher Phase Systems, Five Phase Supply, Inductance of 5-Ph T/m Line, Capacitance of 5-Ph T/m Line, Five Phase Line Model.

Copyright © 2016 International Journal for Modern Trends in Science and Technology
All rights reserved.

I. INTRODUCTION

Multiphase (more than three phase) systems are the focus of research recently due to their inherent advantages compared to their conventional systems. The increased interest in HPO Electric Power Transmission over past thirty years can be traced on a CIRGE paper published by L. D. Barthold and H. C. Barnes [1]. Since that time, the thought of HPO transmission has been described in the literature in several papers and report [2]-[7]. Among the HPO, six-phase transmission appears to be the most promising solution to the need to increase the capability of existing transmission lines. But with Increase in number of phases certainly enhances the complexity of the system. There are no designs regarding odd phases like 3, 7 etc. as far as researchers know. Recently Five-Phase Induction Motor Drive System [8] is proposed due to several advantages over three-phase machines such as lower pulsations in torque, higher density in torque, fault tolerance, stability and lower current ripple.

Already three phase to n (odd) phase transformer connections are proposed [9]. 5-leg inverter is also proposed for Five Phase supply [10-11]. So in future Five Phase supply may preferred for industrial loads. The present work is investigated on Five Phase transmission system. In this paper Weight of the conductor, sag and spacing, Inductance and Capacitance calculations for Five Phase transmission system are demonstrated.

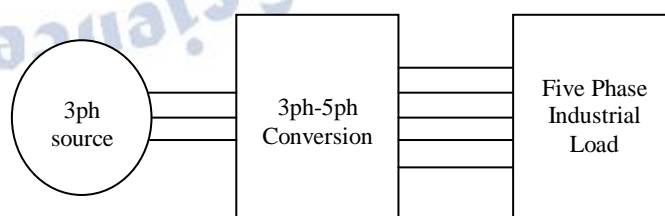


Fig 1: Proposed Scheme Block Diagram

II. FIVE PHASE SUPPLY

Figure 2 shows the Phasor diagram of Five Phase supply. Each phase is displayed by 72° as shown. If

$V_{AN} = V_{BN} = V_{CN} = V_{DN} = V_{EN} = V_{Ph}$ (in magnitude)
 then $V_{AN} = V_{AN} \angle 0^\circ$, $V_{BN} = V_{BN} \angle -72^\circ$, $V_{CN} = V_{CN} \angle -144^\circ$, $V_{DN} = V_{DN} \angle -216^\circ$ and $V_{EN} = V_{EN} \angle -288^\circ$.

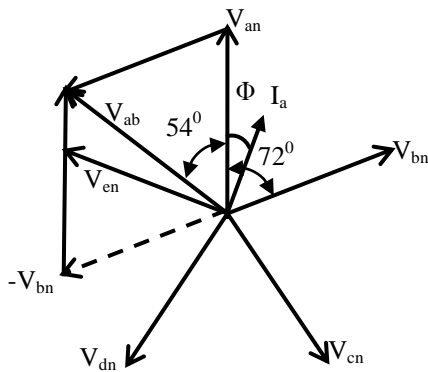


Fig 2: Phasor diagram of Five Phase supply

If V_{AN} is chosen as reference there will be four types of voltage relationships: Lines are displayed by 72° (V_{AB} , V_{BC} etc...), Lines are displayed by 144° (V_{AC} , V_{BD} etc...), Lines are displayed by 216° (V_{AD} , V_{BE} etc...) and Lines are displayed by 288° (V_{AE}). The Voltage relationships are as follows:

$$V_{AB} = V_{Ph} 1.175 \angle 54^\circ \quad (1)$$

$$V_{AC} = V_{Ph} 1.902 \angle 18^\circ \quad (2)$$

$$V_{AD} = V_{Ph} 1.902 \angle -18^\circ \quad (3)$$

$$V_{AE} = V_{Ph} 1.175 \angle -54^\circ \quad (4)$$

Adding all those voltage relationships results as:
 $(V_{AN} = V_{Ph})$

$$V_{AB} + V_{AC} + V_{AD} + V_{AE} = 5 V_{AN}, \quad (5)$$

The above equation is useful in capacitance to neutral calculation for Five Phase line. Five-Phase Voltage relation: $V_L = 1.175 V_{Ph}$ and Five-Phase Power (in the case of balanced system):

$$P = 4.25 V_L I_L \cos\phi. \quad (6)$$

III. SAG AND SPACING IN FIVE PHASE TRANSMISSION LINE

The main factor effecting inductance and capacitance in transmission line is spacing between conductors. Spacing between conductors depends upon sag. Sag depends upon weight of the conductor. So, in order to compute inductance and capacitance of Five Phase transmission line it has to recognize the weight of the conductor, sag of the conductor and spacing between conductors. Taking into consideration 5 phase- 5 wire system, weight of the conductor can be calculated as follows:

$$\text{Line current} \quad I_L = \frac{P}{4.25 V_L \cos\phi} \quad (7)$$

$$\text{Power Loss} \quad P_L = 5 I_L^2 R \quad (8)$$

$$P_L = \frac{5 P^2 \times \rho \times l}{18.0625 \times V_L^2 \cos^2 \phi \times a} \quad (9)$$

From above equation it can solve for area of cross-section and hence weight of the aluminium conductor will be:

$$W_{AL} = Volume \times D$$

$$W_{AL} = 5al \times D$$

$$W_{AL} = \frac{1.384 P \times \rho \times l^2}{V_L^2 \cos^2 \phi \times (1 - \eta)} \times D \quad (10)$$

Where,

P is power to be transmitted.

l is length of the conductor.

D is specific gravity of aluminium.

ρ is resistivity of aluminium.

V_L is line voltage.

η is efficiency.

If resistivity and specific gravity of steel instead of aluminium were placed in equation (10) then it will get the weight of steel conductor. Generally for 132kv transmission line panther ACSR conductor is used which has 30 aluminium strands and 7 steel strands (Central steel wire with one strand, 1st steel layer with 6 strands, 1st aluminium layer with 12 strands and 2nd aluminium layer with 18 strands). Hence, panther conductor has 81.1% of aluminium and 18.9% of steel. The detail weight calculations of panther ACSR conductor in Five Phase are presented in results section.

Sag can be calculated by using the formula

$$S = W_r L^2 / 8T \quad (11)$$

Where, W_r is Resultant weight per meter length (considering weight of the conductor and wind pressure), L is Span length & T is working tension.

The Spacing of conductors is determined by considerations partly electrical and partly mechanical. Larger spacing causes increase in inductance of the line and hence the voltage drop, so that to keep the latter within a reasonable value the conductors should be as close together as is consistent with prevention of corona. The basic consideration regarding the minimum spacing between conductors is that the electrical clearances between conductors under the worst condition i.e. maximum temperature and wind weight shall not be less than the limits for safety, particularly at the middle of the spans [17]. Empirical formulae commonly employed for determination of Spacing of conductors for an aluminium conductor line is given as:

$$Spacing = \sqrt{S + \frac{150}{V}} \quad (12)$$

Where, S is sag in meters and

V is line voltage in kV.

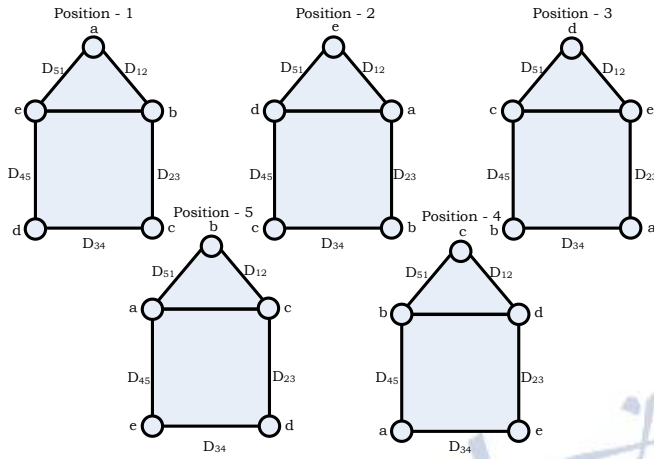


Fig. 3: Fully Transposed Cycle of Five Phase Line

IV. INDUCTANCE OF FIVE PHASE TRANSMISSION LINE

The inductance of a transmission line is calculated as flux linkages per ampere. So far it is considered only single phase and three phase lines. The basic equations for Five Phase lines are also be easily developed. Assuming all conductors with unsymmetrical spacing, the fully transposed cycle is shown in figure 3. For a 5 phase 5 wire line there will no neutral wire, so that $I_a + I_b + I_c + I_d + I_e = 0$. To find the average inductance of one conductor of a transposed line, first determine the flux linkages of a conductor for each position it occupies in the transposition cycle and then determine the average flux linkages. Flux linkages for various positions shown in figure 3 are as follows:

For the 1st position:

$$\lambda_{a1} = 2 * 10^{-7} \left[I_a \ln \frac{1}{r_a} + I_b \ln \frac{1}{D_{12}} + I_c \ln \frac{1}{D_{23}} + I_d \ln \frac{1}{D_{34}} + I_e \ln \frac{1}{D_{45}} \right] \quad (13)$$

For the 2nd position:

$$\lambda_{a2} = 2 * 10^{-7} \left[I_a \ln \frac{1}{r_a} + I_b \ln \frac{1}{D_{23}} + I_c \ln \frac{1}{D_{34}} + I_d \ln \frac{1}{D_{45}} + I_e \ln \frac{1}{D_{51}} \right] \quad (14)$$

For the 3rd position:

$$\lambda_{a3} = 2 * 10^{-7} \left[I_a \ln \frac{1}{r_a} + I_b \ln \frac{1}{D_{34}} + I_c \ln \frac{1}{D_{45}} + I_d \ln \frac{1}{D_{51}} + I_e \ln \frac{1}{D_{12}} \right] \quad (15)$$

For the 4th position:

$$\lambda_{a4} = 2 * 10^{-7} \left[I_a \ln \frac{1}{r_a} + I_b \ln \frac{1}{D_{45}} + I_c \ln \frac{1}{D_{51}} + I_d \ln \frac{1}{D_{12}} + I_e \ln \frac{1}{D_{23}} \right] \quad (16)$$

For the 5th position:

$$\lambda_{a5} = 2 * 10^{-7} \left[I_a \ln \frac{1}{r_a} + I_b \ln \frac{1}{D_{51}} + I_c \ln \frac{1}{D_{12}} + I_d \ln \frac{1}{D_{23}} + I_e \ln \frac{1}{D_{34}} \right] \quad (17)$$

Average flux linkages of conductor 'a' are:

$$\lambda_a = \frac{\lambda_{a1} + \lambda_{a2} + \lambda_{a3} + \lambda_{a4} + \lambda_{a5}}{5} \quad (18)$$

But $I_b + I_c + I_d + I_e = -I_a$

$$\lambda_a = 2 * 10^{-7} I_a \ln \frac{(D_{12} D_{23} D_{34} D_{45} D_{51})^{1/5}}{r_a} \quad (19)$$

The average inductance per phase is:

$$L_a = 2 * 10^{-7} \ln \frac{(D_{12} D_{23} D_{34} D_{45} D_{51})^{1/5}}{r_a} \quad \text{H/m} \quad (20)$$

For equilateral spacing, the inductance of Five Phase transmission line will be same as the inductance of three phase transmission line. But for unsymmetrical spacing the inductance of Five Phase line will be lesser than the inductance of three phase line.

V. CAPACITANCE OF FIVE PHASE TRANSMISSION LINE

To find the capacitance to neutral of a transposed line, first determine the Voltage drop between two conductors (say a and b). The potential difference between a and b for various positions (figure 3) is as follows:

For the 1st position:

$$V_{ab1} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{12}}{r} + q_b \ln \frac{r}{D_{12}} + q_c \ln \frac{D_{23}}{D_{13}} + q_d \ln \frac{D_{24}}{D_{14}} + q_e \ln \frac{D_{25}}{D_{15}} \right] \quad (21)$$

For the 2nd position:

$$V_{ab2} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{23}}{r} + q_b \ln \frac{r}{D_{23}} + q_c \ln \frac{D_{34}}{D_{24}} + q_d \ln \frac{D_{35}}{D_{25}} + q_e \ln \frac{D_{31}}{D_{21}} \right] \quad (22)$$

For the 3rd position:

$$V_{ab3} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{34}}{r} + q_b \ln \frac{r}{D_{34}} + q_c \ln \frac{D_{45}}{D_{35}} + q_d \ln \frac{D_{41}}{D_{31}} + q_e \ln \frac{D_{42}}{D_{32}} \right] \quad (23)$$

For the 4th position:

$$V_{ab4} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{45}}{r} + q_b \ln \frac{r}{D_{45}} + q_c \ln \frac{D_{51}}{D_{41}} + q_d \ln \frac{D_{52}}{D_{42}} + q_e \ln \frac{D_{53}}{D_{43}} \right] \quad (24)$$

For the 5th position:

$$V_{ab5} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{51}}{r} + q_b \ln \frac{r}{D_{51}} + q_c \ln \frac{D_{12}}{D_{52}} + q_d \ln \frac{D_{13}}{D_{53}} + q_e \ln \frac{D_{14}}{D_{54}} \right] \quad (25)$$

The average of all five voltages is:

$$V_{ab} = \frac{V_{ab1} + V_{ab2} + V_{ab3} + V_{ab4} + V_{ab5}}{5} \quad (26)$$

$$V_{ab} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{eq}}{r} + q_b \ln \frac{r}{D_{eq}} \right] \quad (27)$$

Similarly,

$$V_{ac} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{eq}}{r} + q_c \ln \frac{r}{D_{eq}} \right] \quad (28)$$

$$V_{ad} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{eq}}{r} + q_d \ln \frac{r}{D_{eq}} \right] \quad (29)$$

$$V_{ae} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{eq}}{r} + q_e \ln \frac{r}{D_{eq}} \right] \quad (30)$$

$$\text{Where, } D_{eq} = (D_{12} D_{23} D_{34} D_{45} D_{51})^{1/5} \quad (31)$$

$$q_a + q_b + q_c + q_d + q_e = 0$$

Adding equations (27) to (30) results in:

$$V_{ab} + V_{ac} + V_{ad} + V_{ae} = \frac{1}{2\pi k} \left[q_a \ln \frac{D_{eq}}{r} - q_a \ln \frac{r}{D_{eq}} \right] \quad (32)$$

Equating equations (5) and (32), we get:

$$V_{an} = \frac{1}{2\pi k} \left[q_a \ln \frac{(D_{12}D_{23}D_{34}D_{45}D_{51})^{1/5}}{r} \right] \quad (33)$$

So, the capacitance to neutral will be (for air medium Kr=1):

$$C_n = \frac{0.0242}{\ln \frac{(D_{12}D_{23}D_{34}D_{45}D_{51})^{1/5}}{r}} \quad (34)$$

Mathematically there is no difference in the formulae of capacitance to neutral for both three phase and Five Phase, only Deq will get differ. So as phase increases the capacitance to neutral increases, capacitive reactance will reduce and charging current will increases. Hence for the Five Phase long transmission lines, the tower height will be increased. But the weight of aluminium conductor and sag in Five Phase lines get decreased. Spacing between conductors is also reduced in Five Phase lines when compared to three phase lines.

VI. RESULTS AND DISCUSSION

Here all the parameters are calculated in two cases: 1) Conductor spacing used in three phase lines is also used in Five Phase lines. 2) Spacing is separately calculated for Five Phase lines. MATLAB editor is used for calculation of all parameters.

A. Same Spacing is used in Five Phase:

For 132kV three phase transmission line, weight of the conductor, sag of the conductor and spacing between the conductors are calculated by using following parameters:

TABLE I

Parameters used in Three Phase Transmission Lines

| Parameter | Value |
|--------------------------------------|----------|
| Power to be transmitted (MW) | 30 |
| Frequency (Hz) | 50 |
| Line voltage (kV) | 132 |
| Length of line (km) | 120 |
| Resistivity of aluminum (ohm-meter) | 2.6*10-8 |
| Specific gravity of aluminum (Kg/m3) | 2000 |

| | |
|-----------------------|------|
| Power factor | 0.9 |
| Efficiency (%) | 90 |
| Span length | 300 |
| Ultimate strength | 3000 |
| Safety factor | 2 |
| Diameter of conductor | 1cm |
| Wind pressure (Kg/m2) | 29.2 |

The results are obtained by using MATLAB Program which is shown in appendix and results are tabulated in table 2.

TABLE II

Result obtained from the MATLAB Editor for Three Phase Transmission Lines

| Parameters | Value |
|---|-----------|
| Weight of ACSR conductor (Kg / 120 km) | 120229.25 |
| Weight of ACSR conductor (Kg per km) | 1001.910 |
| Weight of ACSR conductor (Kg per meter) | 1.002 |
| Maximum sag in meter | 7.826 |
| Spacing Between Conductors in meter | 3.677 |
| Sag in meter by neglecting wind pressure | 7.514 |
| Spacing Between Conductors in meter by neglecting wind pressure | 3.621 |
| Inductance in mH per km | 1.399 |
| Inductive Reactance in mohm per km | 438.799 |
| Capacitance to neutral in µF per km | 0.003594 |
| Capacitive Reactance in Mohm per km | 0.885705 |
| Charging Current in Ampere per km | 0.086045 |
| Inductance in mH per 120 km | 167.60912 |
| Inductive Reactance in mohm per 120 km | 52655.959 |
| Capacitance to neutral in µF per 120 km | 0.43126 |
| Capacitive Reactance in Mohm per 120 km | 106.2846 |
| Charging Current in Ampere per 120 km | 10.325365 |

With the same spacing of three phase transmission system which are tabulated in table 2, the results are obtained for Five Phase transmission system and tabulated in table 3.

TABLE III

Inductance and Capacitance of Five Phase Transmission System for same spacing

| Parameter | Value |
|--|-----------|
| Inductance in mH per 120 km | 167.6046 |
| Inductive Reactance in mohm per 120 km | 52654.584 |
| Capacitance to neutral in μF per 120 km | 0.432 |
| Capacitive Reactance in Mohm per 120 km | 106.284 |
| Charging Current in Ampere per 120 km | 15.216 |

From table 2 and table 3 it is conclude that without changing the spacing between conductors the inductive reactance is reduced by small extent. Capacitance effect is very less when same spacing is assumed. But the effect of charging current is more in case of Five Phase system.

B. Spacing between conductors in Five Phase transmission line is separately calculated:

For calculating spacing between the lines in Five Phase Transmission system the parameter which are in table 1 are used. A program is written in MATLAB using equations (7) to (34) and results are tabulated in table 4.

TABLE IV
Results for Five Phase Lines

| Parameters | Value |
|---|------------|
| Weight of aluminum Kg per 120 km | 55465.7596 |
| Weight of aluminum Kg per km | 462.214 |
| Weight of aluminum Kg per meter | 0.462215 |
| Maximum sag in Five Phase in meter | 4.1004 |
| Spacing Between Conductors in meter | 2.9049 |
| Sag in meter by neglecting wind pressure | 3.4666 |
| Spacing between Conductors in meter by neglecting wind pressure | 2.74188 |
| Inductance in mH per km | 1.3492 |
| Inductive Reactance in mohm per km | 423.886 |
| Capacitance to neutral in μF per km | 0.003725 |
| Capacitive Reactance in Mohm per km | 0.85448 |
| Charging Current in Ampere per km | 0.13147 |

| | |
|--|------------|
| Inductance in mH per 120 km | 161.9125 |
| Inductive Reactance in mohm per 120 km | 50866.3417 |
| Capacitance to neutral in μF per 120 km | 0.44702 |
| Capacitive Reactance in Mohm per 120 km | 102.5382 |
| Charging Current in Ampere per 120 km | 15.7765 |

By comparing table 2 and table 4 it is conclude that the weight of conductor is significantly decreased to 55465.7596 Kg per 120km from 120229.248 per 120km, maximum sag is decreased to 4.1m from 7.8m and spacing between conductors is decreased to 2.9m from 3.6m. Inductive reactance is also reduced by 1789.618 mH per 120km. But charging current is increased by 5.4515 Ampere per 120 km. For very long transmission lines the effect of charging current will be more then, the tower height has to be increased.

C. Line Model of Five Phase:

To calculate sending-end voltage, sending-end current and sending-end power, sending-end power factor in Five Phase transmission line, by considered the approximate exact equation method.

From above tabulated results the series impedance and the shunt admittance for five phase transmission system are:

Series impedance = $75+j*127.165$ ohm/300km.


Shunt admittance = $3.9e-9$ mho/300km.

The series impedance and the shunt admittance for three phase transmission system are:

Series impedance = $75+j*131.7$ ohm/300km.

Shunt admittance = $3.76e-9$ mho/300km.

Program is written in MATLAB which is in appendix. The results are shown in fig. 4. From those characteristics it concludes that Five Phase supply can be proffered for industrial loads.

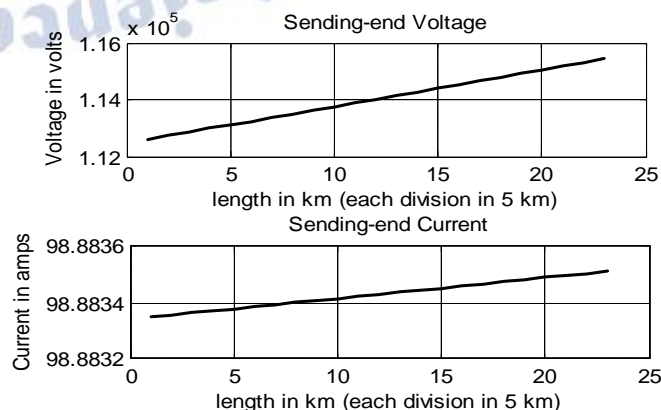

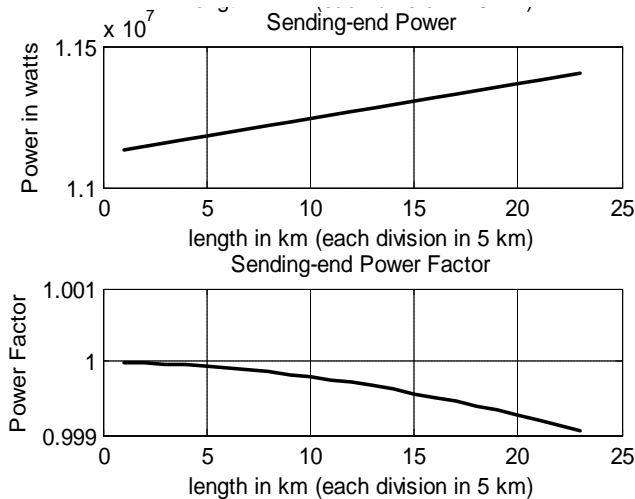


Fig. 4: (a) Sending-end power factor with respect to line length (b) Sending-end voltage with respect to line length (c) Sending-end current with respect to line length (d) Sending-end power with respect to line length

VII. CONCLUSION

This paper proposes a basic concept about Five-Phase Transmission system. It shows the relation between line voltage and phase voltage as well as current and power relations. Spacing between conductors in Five Phase is also determined. Complete calculations of line parameters in Five Phase are done. Here, compiled the line model in Five Phase system. In future the research has to be concentrated on fault analysis and protection of Five Phase system.

APPENDIX

a. Program for finding weight, seg, spacing, inductance and capacitance:

```
T=US/S;
Ww=WP*D;
n=eff/100;
l=len*1000;
Wal=(1.384*p1*P*d)/((1-n)*Vl*Vl*pf*pf);
Ws=(1.384*p1*P*d1)/((1-n)*Vl*Vl*pf*pf);
Wacsr=(0.810811*Wal)+(0.189189*Ws);
Wacsr1=Wacsr/len;
Wacsr2=Wacsr/(len*1000);
Wr=sqrt((Wacsr2^2)+(Ww^2));
Sag=(Wr*L*L)/(8*T);
Sag1=(Wacsr2*L*L)/(8*T);
Spacing=(sqrt(Sag))+(Vl/150000);
Spacing1=(sqrt(Sag1))+(Vl/150000);
D12=Spacing;
D23=Spacing;
D45=Spacing;
D51=Spacing;
```

```
D34=((Spacing+Spacing)-0.2);
r=(D/2)*100;
Vn=Vl/1.175;
GMR=0.7788*r;
GMD=(D12*D23*D45*D51*D34)^(1/5);
GMD1=(GMD*100);
Ind=0.2*(log(GMD1/GMR));
Cap=0.0242/(log(GMD1/r));
Xn=1/(2*pi*f*Cap);
Xl=2*pi*f*Ind;
Ic=Vn/(Xn*1000000);
Ind1=Ind*len;
Cap1=Cap*len;
Xn1=Xn*len;
Xl1=Xl*len;
Ic1=Ic*len;
```

In the above program: US is ultimate strength, S is safety factor, WP is wind pressure, D is diameter of conductor, n=efficiency, Wal is weight of aluminum, Ws is weight of steel conductor, Wacsr is weight of acsr conductor, Ind is inductance, Cap is Capacitance to neutral, len is length of the transmission line, Xl is inductive reactance, Xn is capacitive reactance and Ic is charging current.

b. Program for finding sending - end voltage, sending - end current and sending - end power factor in Five Phase:

```
IR = PR/(VR*pfload);
z = Z/l;
y = Y/l;
i = 1;
for l = 10:5:120,
    A = 1+(y*1)*(z*1)/2
    B = (z*1)*(1+(y*1)*(z*1)/6)
    C = (y*1)*(1+(y*1)*(z*1)/6)
    D = A
    Vs_approx(i) = A*VR+B*IR
    Is_approx(i) = C*VR+D*IR
    Spf_approx(i) = cos(angle(Vs_approx(i)
angle(Is_approx(i))))
    Spower_approx(i)=
real(Vs_approx(i)*conj(Is_approx(i)))
    point(i) = i
    i = i+1
end
```

REFERENCES

- [1] L. D. Barthold and H. C. Barnes, "High-Phase Order Transmission", *CIGRE Study Committee, London, U.K. Rep. No. 31. 1972.*
- [2] J. R. Stewart, D. D. Wilson, "High Phase Order Transmission-A Feasibility Analysis: Part I-Steady State Considerations," *IEEE Transactions on Power*

- Apparatus and Systems*, Vol. PAS-97, No.6, pp. 2300-2307, November/December, 1978.
- [3] J. R. Stewart, D. D. Wilson, "High Phase Order Transmission-A Feasibility Analysis: Part II-Overvoltages and Insulation Requirements," *IEEE Transactions on Power Apparatus and Systems*, Vol. AS-97, No.6, pp. 2308-2317.
- [4] C. M. Portela and M. C. Tavares, "Six-Phase Transmission Line Propagation Characteristic and New Three-Phase Representation," *IEEE Transactions on Power Delivery*, Vol. 8, pp. 1470-1483, 1993.
- [5] W. C. Guiker, S. S. Venkata and N. B. Bhatt, "Six-Phase (Multi-Phase) Power Transmission Systems: Faults Analysis," *IEEE Transactions on Power Apparatus and Systems*, Vol. PAS-96, No. 3, May/June, 1977.
- [6] E. H. Badawi, M. K. E. Sherbiny, and A. A. Ibrahim, "A Method of Analysing Unsymmetrical Fault on Six-Phase Power Systems," *IEEE Transactions on Power Delivery*, Vol. 6, No.3, July 1991.
- [7] T. L. Landers, R. J. Richeda, E. Krizauskas, J. R. Stewart, and R. A. Brown, "High Phase Order Economics: Constructing a New Transmission Line," *IEEE Transactions on Power Delivery*, Vol. 13, No. 4, pp. 1521-1526, October 1998.
- [8] Atif Iqbal, IEEE, Sk. Moin Ahmed, IEEE, "Modeling, Simulation and implementation of Five Phase induction motor drive system", *IEEE International Joint Conference of Power Electronics, Drives and Energy Systems - 2010*.
- [9] Atif Iqbal, Member, IEEE, Shaikh Moinuddin, M. Rizwan Khan, Sk. Moin Ahmed, and Haithem Abu-Rub, "A Novel Three-Phase to Five-Phase Transformation Using a Special Transformer Connection", *IEEE transactions on power delivery*, vol. 25, no. 3, pp. 1637-1744, July 2010.
- [10] K. P. Prasad Rao, B. Krishna Veni, D. Ravi Teja, "Five Leg Inverter for Five Phase Supply," *International Journal of Engineering Trends and Technology-Volume3, Issue2- 2012*, pp. 144 - 152.
- [11] K. P. Prasad Rao, B. Jyothi and V. Naga Surekha, "Comparison of Specially Connected Transformer Scheme and Five Leg Inverter for Five Phase Supply" *Annual IEEE India Conference, 2011*.
- [12] M. W. Mustafa, IEEE member, M. R. Ahmad and H. Shareef, "Fault Analysis on Double Three-Phase to Six-Phase Converted Transmission Line" *International Power Engineering Conference (IEEE)* vol. 2, pp.1030 - 1034, November/December, 2005.
- [13] Nagrath I.J., and Kothari, D.P., *Power System Engineering, New Delhi, Tata McGraw-Hill Publishing Company Limited, 1995*.
- [14] Wadhwa C.L., *Electrical Power Systems, New Delhi, New Age International publishers, 2005*.
- [15] John J. Grainger., and William D. Stevenson, *Power System Analysis, New york, McGraw-Hill publishers, 1994*.
- [16] L.P. Singh, "Advanced Power System Analysis & Dynamics," *New Age International Publishers, 6th Revised Edition*.
- [17] J.B.Gupta, "A Course in Power Systems," *New Delhi, S.K. Kataria & Sons Publishers, 2005*.