



PV-Based Shunt Active Power Filter for Improving Power Quality in Accordance with the P-Q Theory

M. Jyothi Kumar¹ | K.Varalakshmi²

¹PG Scholar, Department of Electrical & Electronics Engineering, Aditya College of Engineering and Technology, Surampalem India

²Sr.Assistant Professor, Department of Electrical & Electronics Engineering, Aditya College of Engineering and Technology, Surampalem India

To Cite this Article

M. Jyothi Kumar and K.Varalakshmi. PV-Based Shunt Active Power Filter for Improving Power Quality in Accordance with the P-Q Theory. International Journal for Modern Trends in Science and Technology 2022, 8(06), pp. 372-381. <https://doi.org/10.46501/IJMTST0806065>

Article Info

Received: 18 May 2022; Accepted: 13 June 2022; Published: 18 June 2022.

ABSTRACT

Nowadays, active filters are a feasible choice for reducing harmonic levels in the electrical installations of industrial customers. This is because active filters can filter out unwanted harmonics. There is no one approach that is universally accepted for ranking the active filters, which is something that needs to be kept in mind despite the fact that there are numerous unique filter setups that can be employed. The fundamental principles of SAPF as well as the theoretical notions that describe the structure and design of shunt active power filters are the primary topics of this study. The p-q theory of instantaneous power serves as the foundation for the filter controller, which also makes use of the circuit's functionality as an inverter with PWM hysteresis control. Matlab-Simulink was utilised to design a model in order to verify the effectiveness of shunt active filters. The findings of the simulation are provided, which demonstrate that the power quality of the grid has been improved.

KEYWORDS— Active power filter (APF), instantaneous power theory, photovoltaic (PV), power quality, renewable energy.

1. INTRODUCTION

Although power quality (PQ) issues in power distribution networks have been there for some time, it is only very recently that the effects of these issues have come to the attention of the general public. Over the course of the last ten years, developments in semiconductor device technology have been the driving force behind a revolution in power electronics, and there are indications that this trend may continue [1]. However, modern power equipments, which include adjustable-speed motor drives (ASDs), electronic power supplies, direct current (DC) motor drives, battery chargers, and electronic ballasts, are to blame for the increase in associated PQ issues [2]-[4]. These nonlinear

loads are manufactured using nonlinear devices, in which the current that flows through them is not proportional to the voltage that is supplied. The idea of current distortion can be demonstrated with the use of a straightforward circuit, such as the one shown in Figure 1.1. In this scenario, a sinusoidal voltage is given to a simple nonlinear resistor, which causes both the voltage and the current to change in accordance with the curve that is displayed. The current that is produced as a result of the perfectly sinusoidal voltage is, however, warped.

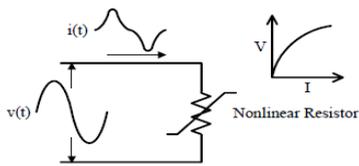


Figure 1.1 Current distortion caused by nonlinear resistance

It would appear that nonlinear loads are the primary contributors to harmonic distortion inside a power distribution system. Through the point of common coupling, the harmonic currents that are generated by nonlinear loads are fed back into the power distribution systems (PCC). These harmonic currents have the potential to have unfavourable interactions with a wide variety of power system equipment, most notably capacitors, transformers, and motors, which can result in increased losses, overheating, and overloading [2, 4]. In recent times, there has been a rising level of concern for the environment. The necessity of producing energy that is free of pollution has prompted a significant amount of effort toward renewable energy (RE). Sunlight, wind, flowing water, and biomass are examples of renewable energy sources that hold the potential to produce energy that is both clean and plentiful. They do not contribute to the production of any greenhouse gases and can never be used up. Solar power, in particular, is becoming an increasingly viable option in countries with abundant sunshine like Malaysia. This energy comes in the form of direct current and is generated by photovoltaic (PV) arrays. Using a system known as an inverter, the power is changed into a kind of electricity known as alternating current (AC), which is more practical. A combined APF and PV array installation is something that has been worked on. Despite this, it does not appear that anyone has attempted to integrate an APF with a PV array to create a hybrid system. In any developing nation, the amount of power that is required never meets the amount of power that is generated. In order to supplement the power generation that is based on fossil fuels, thus, renewable power generating systems such as photovoltaic and wind energy conversion systems are utilised. However, because the load is a diode bridge rectifier with RL- load, there is non-linearity in the load, which results in harmonics in the load currents. Therefore, using a voltage source inverter connected in parallel with the system, which functions

as a shunt active power filter (APF) for the purpose of reducing the distortions produced due to non-linear load in the load current, can accomplish both the reduction of harmonics and the compensation of reactive power simultaneously. This active filter produces a compensatory current that has the same amplitude as the harmonic current but is 180 degrees out of phase with it. This helps to lessen the amount of harmonics that are present in the load current. APF can be either series, shunt, or a combination of both series and shunt, but the shunt type is the one that is recommended in this case. This is due to the fact that the principle behind the shunt type of APF is to generate compensating currents that are equal in magnitude but opposite in phase to harmonics that are caused by non-linear loads. A closed loop structure known as SAPF can make non-linear loads behave as if they were linear. It is also capable of mitigating harmonics and distortions, in addition to compensating for reactive power.

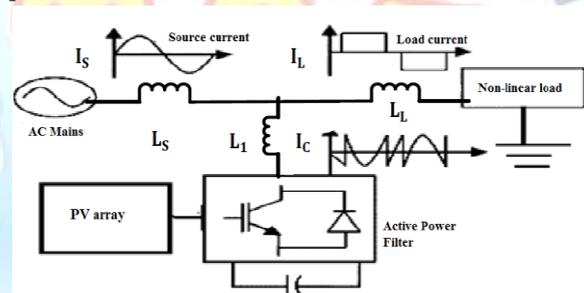


Fig.1.2 Principle of shunt APF

In Fig. 1.2 AC mains is connected to the non-linear load that is diode bridge rectifier with RL-load where,

I_s - Source current

I_L - Load current produced due to non-linear load

I_c - Compensating current produced by shunt APF to mitigate harmonics

L_s - Source inductance

L_L - Load inductance

L_1 - Coupling inductance

Here, the shunt APF produced compensating currents of equal in magnitude but opposite in-phase to those harmonics that are present due to non-linear loads which results in mitigation of harmonics at load current. Generally, the voltage source inverters (VSI) are used to convert the power of the PV system to inject it to the distribution system. But here, the VSI act as a

multifunctional device which is used for energy conversion and also for harmonics elimination as well as reactive power compensation simultaneously. This control strategy incorporates P-Q solution as in shunt active power filter technique. This control technique is same as technique used in shunt filter to reduce harmonics in the distribution network due to non-linear loads in the system.

2. LITERATURE SURVEY

Due to the presence of non-linear loads harmonics are generated in the load current. Hence, it is required to reduce the load current harmonics. So, Shunt APF is needed for harmonics reduction and for reactive power compensation.

In 2011 Chaitanya et. al described the PV array mathematical modeling and also the MPPT algorithm implementation on a boost converter to track maximum power during rapid change in environment conditions. The complete PV model is simulated and P-V and I-V curves are drawn using MATLAB/SIMULINK and the results are discussed from which it is clear that the P-V and I-V curves are dependent on temperature and irradiation. Using MPPT algorithm, a PV system can be operated at maximum efficiency [19].

In 2014 Jeevanathan et. al described that a SAPF is a current control system that is used for reduction of harmonics in current by injecting a current of equal magnitude but opposite in phase of the harmonics in current and also reactive current produced from the non-linear loads such that only fundamental active currents can be supplied from the ac source to the loads. This technique is used for both harmonic reduction along with reactive compensation produced due to non-linear loads. As a result, efficiency of the system is increased with reduced value of THD in source current [18].

In 2014 Remya et. al discovered that due to increase in power demand, the power distribution also increased so Renewable Energy Sources (RES) are connected to the distribution systems where inverter, converter and non-linear loads are present hence, harmonics are present in currents and power quality decreases. So, they used to reduce the harmonics as well as for reactive power compensation. Here, the PV system is connected to the grid through a three-phase inverter which is used

as a multi-functional device as it is used as power converter also for harmonics elimination [21].

In 2014 Boukezata et. al presented a paper where active filter is used to compensate the reactive power and to inject active power simultaneously whenever needed by the nonlinear loads. The PV array model with boost converter and MPPT controller is directly connected to the dc-side voltage source inverter(VSI) and the PV system is connected to the grid through this inverter using Direct Power Control Algorithm [10].

In 2013, Belaidi et. al described the analysis and simulation of shunt active filter (SAPF) where a PV system is connected to shunt power active filter and it can be used for the harmonics elimination which is generated by a nonlinear load and also reactive power compensation is done here. For the reference current calculation of Shunt Active Filter We are using the synchronous d-q-o reference frame algorithm (SRF) and the carrier-based PWM modulation is used for gating signal generation for the voltage source inverter. This system produced current in sinusoidal form only in multiples frequency of fundamental and also reactive power compensation occurred [16].

In 2012, Blorfan et. al presented a paper where a hybrid three-phase active power filter(HAPF) is configured and a passive high-pass filter is connected in parallel with an active power filter and then to a photovoltaic system. This configuration is able to improve the filtering capability of an active filter (APF) using sliding mode control and was able to filter out small band as well as wideband harmonics. This sliding mode method track the reference current and also give source current THD at a very lesser value which indicates the effectiveness of the system [4, 15].

3. PV SYSTEM

3.1 Definition

A photovoltaic system is a system which uses one or more solar panels to convert solar energy into electricity. It consists of multiple components, including the photovoltaic modules, mechanical and electrical connections and mountings and means of regulating and/or modifying the electrical output [14].

3.2 Photovoltaic Arrangements

3.2.1 Photovoltaic Cell

PV cells are made of semiconductor materials, such as silicon. For solar cells, a thin semiconductor wafer is

specially treated to form an electric field, positive on one side and negative on the other. When light energy strikes the solar cell, electrons are knocked loose from the atoms in the semiconductor material. If electrical conductors are attached to the positive and negative sides, forming an electrical circuit, the electrons can be captured in the form of an electric current - that is, electricity. This electricity can then be used to power a load[16]. A PV cell can either be circular or square in construction.

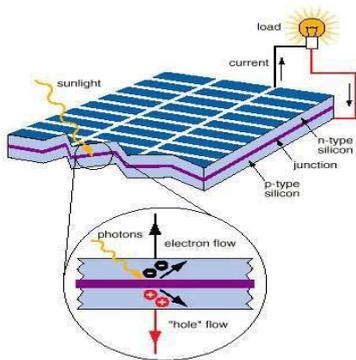


Figure 3.1 Basic Structure of PV Cell

3.2.2 Photovoltaic Module

Due to the low voltage generated in a PV cell (around 0.5V), several PV cells are connected in series (for high voltage) and in parallel (for high current) to form a PV module for desired output. Separate diodes may be needed to avoid reverse currents, in case of partial or total shading, and at night. The p-n junctions of mono-crystalline silicon cells may have adequate reverse current characteristics and these are not necessary. Reverse currents waste power and can also lead to overheating of shaded cells. Solar cells become less efficient at higher temperatures and installers try to provide good ventilation behind solar panels [15].

3.2.3 Photovoltaic Array

The power that one module can produce is not sufficient to meet the requirements of home or business. Most PV arrays use an inverter to convert the DC power into alternating current that can power the motors, loads, lights etc. The modules in a PV array are usually first connected in series to obtain the desired voltages; the individual modules are then connected in parallel to allow the system to produce more current [14].

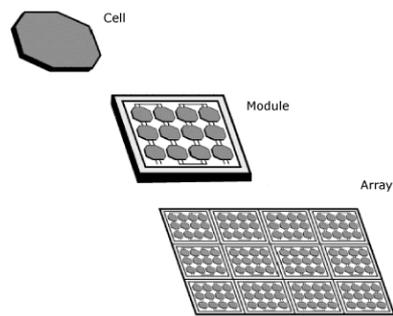


Figure 3.2 Photovoltaic system [16]

4. SHUNT ACTIVE POWER FILTER

In the recent years of development the requirement of harmonic and reactive power has developed, causing power quality problems. Many power electronic converters are used in industries as well as in domestic purpose. The power converter loads offer highly nonlinear characteristic in their input currents. These currents drawn by power converters have a wide spectrum that includes: fundamental reactive power, third, fifth, seventh, eleventh and thirteenth harmonics in large quantities and other higher frequency harmonic are in small percentage. These currents at the consumer bus further distort the voltage spectrum thus becoming troublesome problems in AC power lines. As passive power filters doesn't reaches the desired performance a power electronic solution has emerged. Most of the common loads that can be watched in daily life at industries are balanced three phase loads and single-phase loads with different loading on them making the system unbalance.

This chapter basically deals with the modeling and investigation of shunt active power filter for compensation of harmonics and reactive power. Designs of different parameters like power circuit, control circuit, control strategies, EMI / Ripple filters are discussed. The three leg topology shown in fig 4.1 is basically used for three-phase balanced loads.

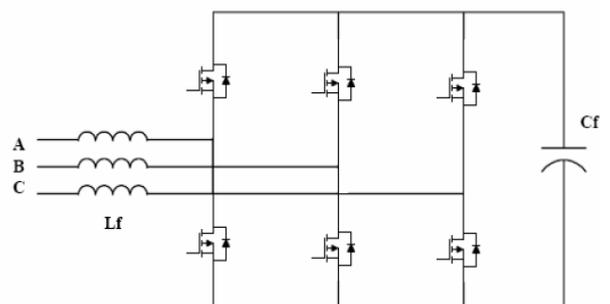


Fig 4.1 Three leg topology of shunt active power filter

4.1 Basic compensation principle of STATCOM

The shunt active power filter, with a self controlled dc bus, has a topology similar to that of a static compensator (STATCOM) used for reactive power compensation in power transmission systems. Shunt active power filters compensate load current harmonics by injecting equal but opposite harmonic compensating current. In this case the shunt active power filter operates as a current source injecting the harmonic components generated by the load but phase shifted by 180°. Fig 4.2 shows the connection of a shunt active power filter and Fig 4.3 shows how active power filter works to compensate the load harmonic currents[4].

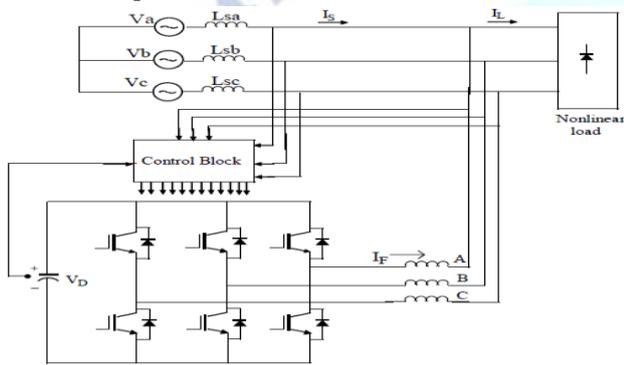


Fig 4.2 Shunt power filter topology

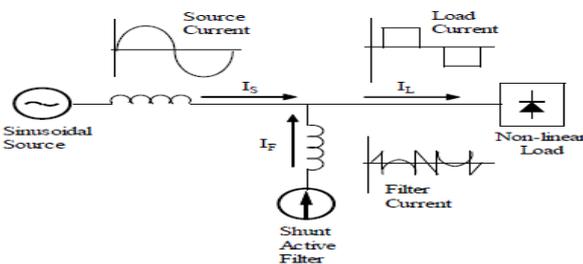


Fig 4.3 Filter current I_F generated to compensate load current harmonics

Fig 4.4 shows the basic compensation principle of shunt active power filter. A voltage source inverter (VSI) is used as the shunt active power filter[10]. This is controlled so as to draw or supply a compensating current I_c from or to the utility, such that it cancels current harmonics on the AC side i.e. this active power filter (APF) generates the nonlinearities opposite to the load nonlinearities. Fig 5.5 shows the different waveforms i.e. the load current, desired source current and the compensating current injected by the shunt active power filter which contains all the harmonics, to make the source current purely sinusoidal. This is the basic principle of shunt active power filter to eliminate

the current harmonics and to compensate the reactive power.

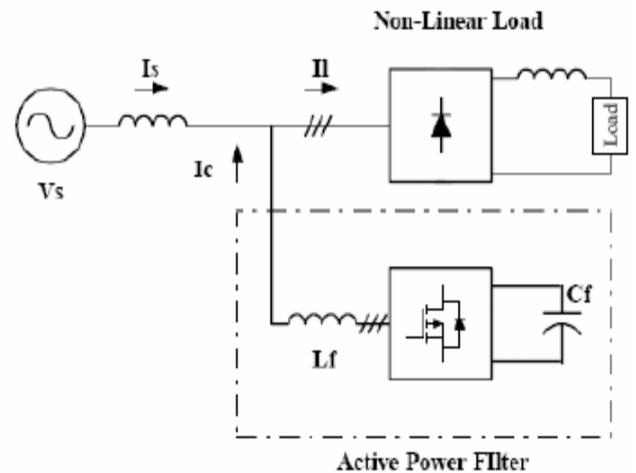


Fig 4.4 Basic compensation principle

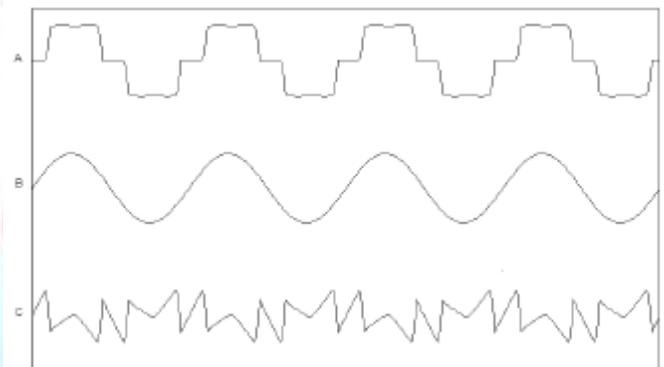


Fig 4.5 Actual load, desired source and the compensating current

5. GRID CONNECTED PV SYSTEM WITH ACTIVE POWER FILTER

A Shunt Active Filter (SAFP) is the bidirectional current converter with six switches having combination of both switching network and filter-components. Structure of this power filter is dependent on the control technique of VSI having a capacitor for the purpose of DC energy storage and the inverter output has been connected to Non-linear load having diode rectifier bridge with a RL-load. In each of the switches the diodes are connected in anti-parallel arrangement with the IGBTs to permit current flow in either direction. For compensation of reactive power the PV interconnected shunt APF injects real PV power to a distribution line at PCC and also reduces harmonic in load currents caused by nonlinear loads by injecting compensating current. This filter is connected in shunt that means in parallel with the nonlinear load. This active filter has capability of detecting the harmonic currents caused by the nonlinear loads and then injects a current of equal

magnitude and opposite in phase with the non-linear load current which is called compensating current to reduce the harmonics present in load currents due to Non-linear load. Hence, the resulting current is in form of a fundamental frequency sinusoidal current which is drawn at PCC in distribution network.

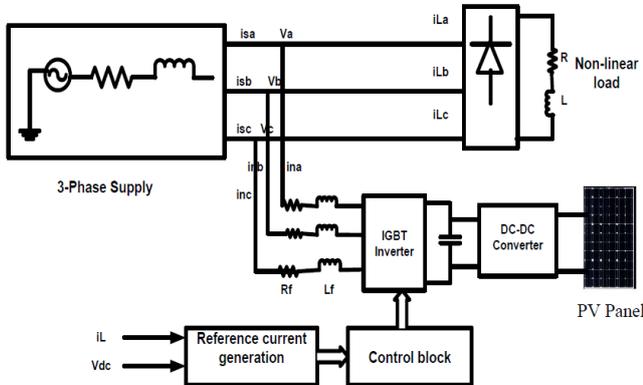


Fig.5.1 Schematic diagram of a PV system connected to a Shunt APF

p-q theory Based Control

Akagi et al in 1983 [3] developed P-Q theory or "instantaneous active-reactive Power theory" for controlling the active filters. This can be achieved by transforming the voltage and load current into α - β co-ordinates.

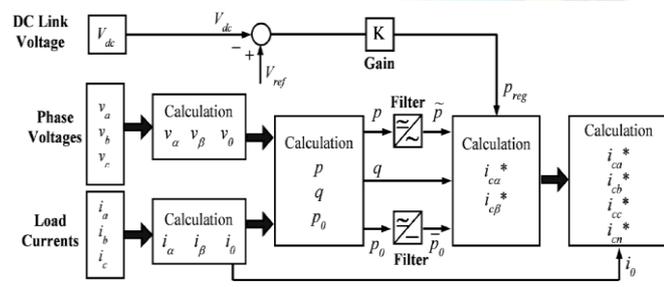


Fig.5.2 Block diagram of p-q compensation theory

P-Q theory can be achieved by transforming the voltage and load current into α - β co-ordinates as following

$$\begin{bmatrix} V_{\alpha} \\ V_{\beta} \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & -\frac{1}{2} & -\frac{1}{2} \\ 0 & \frac{\sqrt{3}}{2} & -\frac{\sqrt{3}}{2} \end{bmatrix} \begin{bmatrix} V_a \\ V_b \\ V_c \end{bmatrix}$$

$$\begin{bmatrix} i_{L\alpha} \\ i_{L\beta} \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & -\frac{1}{2} & -\frac{1}{2} \\ 0 & \frac{\sqrt{3}}{2} & -\frac{\sqrt{3}}{2} \end{bmatrix} \begin{bmatrix} i_{La} \\ i_{Lb} \\ i_{Lc} \end{bmatrix}$$

The instantaneous active power p_L and reactive power q_L can be expressed as

$$\begin{bmatrix} p_L \\ q_L \end{bmatrix} = \begin{bmatrix} V_{\alpha} & V_{\beta} \\ V_{\beta} & -V_{\alpha} \end{bmatrix} \begin{bmatrix} i_{L\alpha} \\ i_{L\beta} \end{bmatrix}$$

These p_L and q_L power can be divided into oscillatory and average terms as following

$$p_L = \bar{p} + p$$

$$q_L = \bar{q} + q$$

where,

\bar{p} = Instantaneous real power Mean value and is treated as desired power component that can be transferred from source to load.

p = Instantaneous real power alternated value and has to be compensated as it is not involve in power transfer between the source to load.

\bar{q} = Instantaneous imaginary power mean value and it is related to the exchanges of power between the load phases which results in undesired current, so it has to be compensated.

q = Instantaneous imaginary power alternated value and is same as conventional reactive- power that has been compensated by using the APF.

In p-q theory assumed voltages are sinusoidal in nature so the power is to be calculated using these sinusoidal voltages.

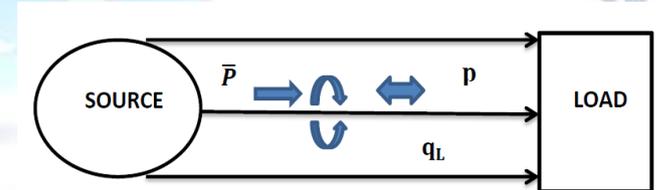


Fig.5.3 p-q theory power components

The powers that have to be compensated are described as below

$$p_c = -p + p_{loss}$$

$$q_c = -q_L$$

where,

p_{loss} = desired active power for compensating filter loss and for desired dc link voltage. By inverting the matrix we can obtain the reference compensation currents as follows

$$\begin{bmatrix} i_{ca} \\ i_{c\beta} \end{bmatrix} = \frac{1}{V_{\alpha}^2 + V_{\beta}^2} \begin{bmatrix} V_{\alpha} & V_{\beta} \\ V_{\beta} & -V_{\alpha} \end{bmatrix} \begin{bmatrix} -p + p_{loss} \\ -q_L \end{bmatrix}$$

$$\begin{bmatrix} i_{ca}^* \\ i_{cb}^* \\ i_{cc}^* \end{bmatrix} = \sqrt{\frac{2}{3}} \begin{bmatrix} 1 & 0 \\ -1 & \frac{\sqrt{3}}{2} \\ -1 & -\frac{\sqrt{3}}{2} \end{bmatrix} \begin{bmatrix} i_{ca} \\ i_{c\beta} \end{bmatrix}$$

- For separation of the instantaneous power direct term from alternating one a Low Pass Filter (LPF) with feed-forward effect is used.
- DC-link voltage regulator is responsible for compensation as well as for transient response.

Hence, the actual value of DC-capacitor voltage has to be compared with the reference one and the Differential error is fed to a PI-control.

6. SIMULATION RESULTS

6.1 Conventional Simulation Circuit

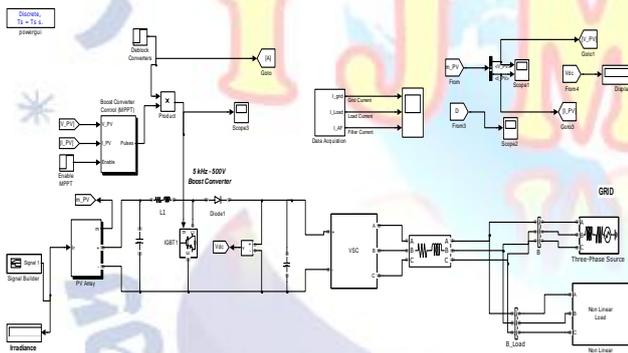


Fig 6.1 Conventional Simulation Circuit

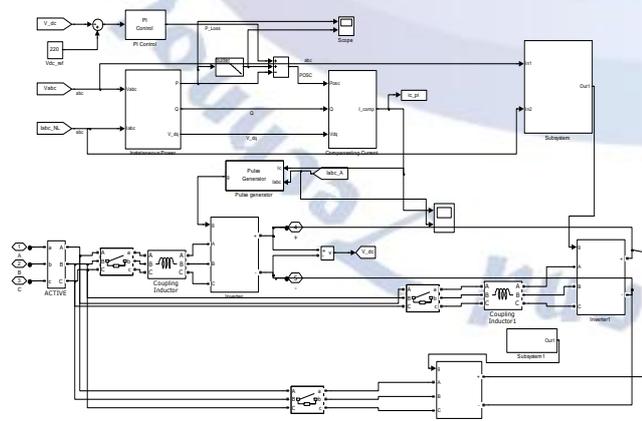


Fig 6.2 VSC with Filter

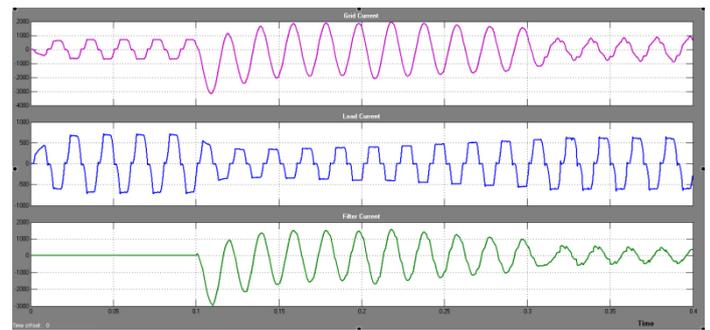


Fig 6.3 Grid Current, Load Current, Filter Current

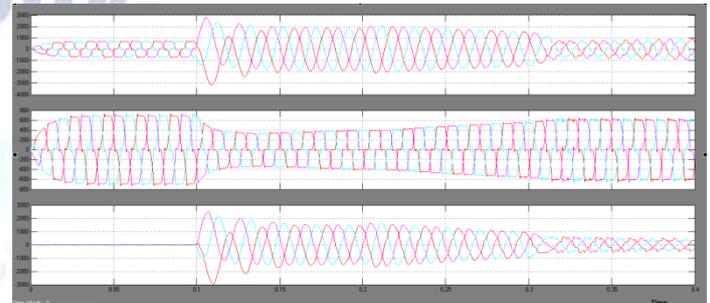


Fig 6.4 Three phase Grid Current, Load Current, Filter Current

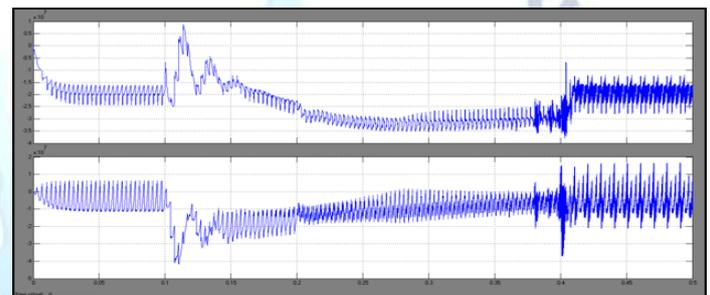


Fig 6.5 Active Power and Reactive Powers

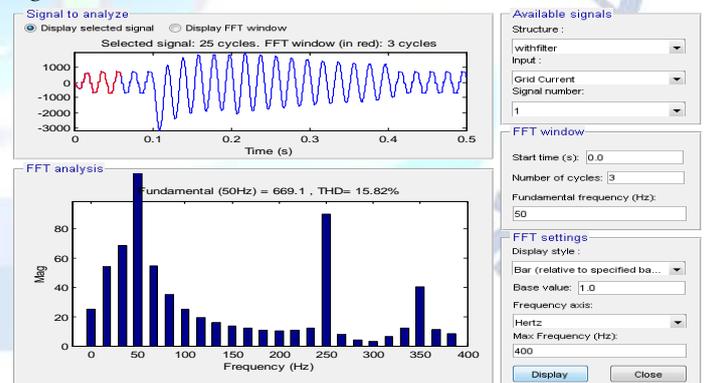


Fig 6.6 THD Without Filter

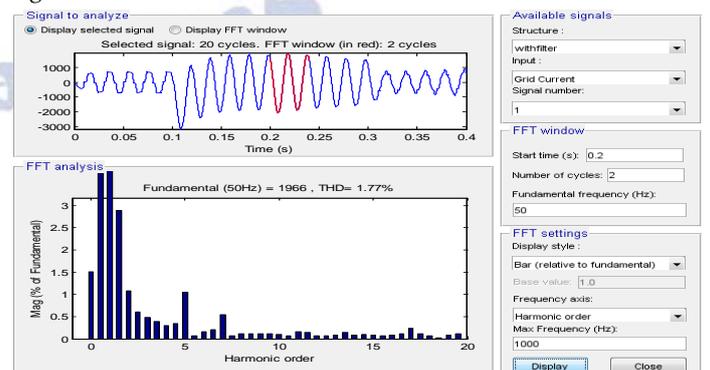


Fig 6.7 THD with Filter

Proposed Simulation Circuit

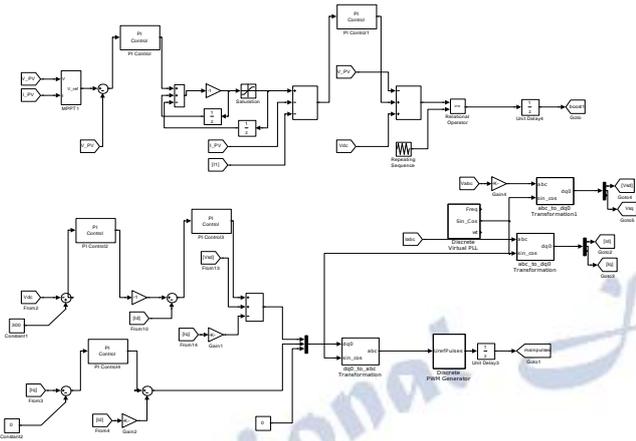


Fig 6.8 Proposed P-Q control theory

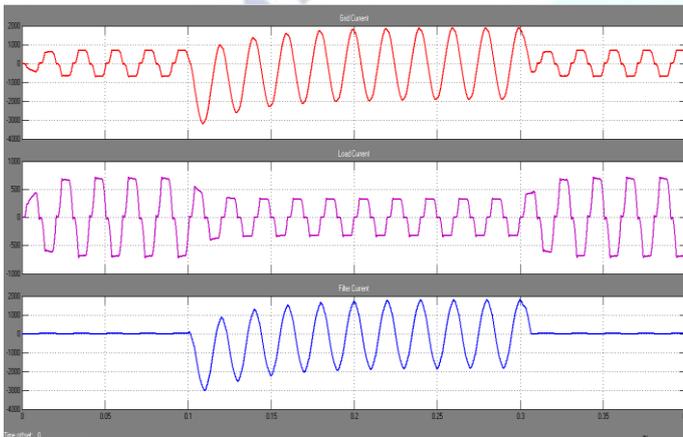


Fig 6.9 Grid Current, Load Current, Filter Current

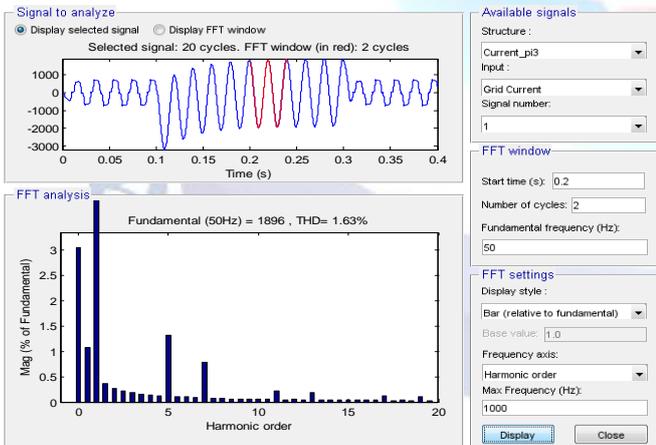


Fig 7.0 THD of Grid Current for Proposed circuit

Table: Comparison of THD for conventional and proposed methods

Conventional circuit without filter	15.82%
Conventional circuit with filter	1.77%
Proposed circuit with filter	1.63%

7. CONCLUSION

The P-Q theory is used to the simulation data presented in this study in order to identify the load, the source, and the harmonic current. Altering the shape of the source current such that it more closely resembles a sine wave is an efficient way to compensate for harmonics that are present in the load current. The reactive power adjustment may be seen clearly in the graphs of the active and reactive power before and after the filter was activated.

Conflict of interest statement

Authors declare that they do not have any conflict of interest.

REFERENCES

- [1] B. Subudhi, R. Pradhan, "A Comparative Study on Maximum Power Point Tracking Techniques for Photovoltaic Power Systems" IEEE Transactions on Sustainable energy, vol. 4, no. 1, January 2013.
- [2] H. Akagi, "Instantaneous Power Theory and Applications to Power Conditioning", February 2007, Wiley-IEEE Press.
- [3] R. Panigrahi, B. Subudhi and P. C Panda, "Model predictive-based shunt active power filter with a new reference current estimation strategy", IET Power Electron., 2015, Vol. 8, Iss. 2, pp. 221–233.
- [4] H. Akagi, Y. Kanmawa, K. Fujia, A. Nabae, "Generalized Theory of the instantaneous Reactive Power and its Application", Trans. IEEE Vol. 103-H, No. 7. 1983.
- [5] J. Harada and G. Zhao, "Controlled power-interface between solar cells and ac sources," in IEEE Conf., 1989, pp. 22.1/1-22.1/7.
- [6] Moleykutty George and Kartik Prasad Basu "Three-Phase Shunt Active Power Filter" American Journal of Applied Sciences 5 (8), 2008 pp.909-916.
- [7] Moulali, S., Vijay Muni, T., Bala Subrahmanyam, Y., & Kesav, S. (2018). A flying capacitor multilevel topology for pv system with apod and pod pulse width modulation. Journal of Advanced Research in Dynamical and Control Systems, 10(2), 96–101.
- [8] Harshith, I., Raj, B. P., Raja Sekhar, G. G., & Muni, T. V. (2019). A novel methodology for single phase transformerless inverter with leakage current elimination for pv systems application. International Journal of Innovative Technology and Exploring Engineering, 8(6), 1017–1021.
- [9] Mounika Muppavarapu, G G Rajasekhar, T Vijay Muni, R B R Prakash. ENHANCEMENT OF POWER QUALITY IN A GRID CONNECTED UDE BASED PV INVERTER. JCR. 2020; 7(2): 340-343. doi:10.31838/jcr.07.02.65
- [10] Bhargavi, R., Ganesh, P., Raja Sekhar, G. G., Prakash, R. B. R., & Muni, T. V. (2020). Design and implementation of novel multilevel inverter. Journal of Advanced Research in Dynamical and Control Systems, 12(2), 1322–1328. <https://doi.org/10.5373/JARDCS/V12I2/S20201169>
- [11] Ayman Blofan, Patrice Wira, "PV energy generation for an autonomous shunt active power filter", 2011.

- [12] H. Akagi, "New Trends in Active Filters for Power Conditioning," *IEEE Trans. on Industry Applications*, 1996, vol. 32, no. 6, pp. 1312-1322.
- [13] Hiren Patel and Vivek Agarwal, "Maximum Power Point Tracking Scheme for PV Systems Operating Under Partially Shaded Conditions", *IEEE Transactions on Industrial Electronics*, Vol.55, No.4, pp 1689-1698, 2008.
- [14] T. Eswaran and P. L. Chapman, "Comparison of photovoltaic array maximum power point tracking techniques," *IEEE Trans. on Energy Conversion*, vol. 22, no. 2, June 2007.
- [15] M. C. Benhabib and S. Saadate, "New Control approach for four wire active power filter based on the use of synchronous reference frame," *Elsevier Electric power systems Research* 73, 2005, 353-362.
- [16] Eswaran Chandra Sekaran, "Analysis and simulation of a new shunt active Power filter using cascaded multilevel inverter" *Journal of electrical engineering*, vol. 58, no. 5, 2007, 241-249.
- [17] B. Boukezata, A. Chaoui, J. P. Gaubert and M. Hachemi, "Active Power Filter in a transformer-less Grid Connected Photovoltaic System" *Balkan Journal of electrical & computer engineering*, 2014, vol.2, no.3.
- [18] M. Park, N.G. Seong and I.K. Yu, "A Novel Photovoltaic Power Generation System including the Function of Shunt Active Filter," *KIEE International Transactions on EMECS*, Vol. 3B-2, pp. 103-110, June, 2003.
- [19] M. Elshaer, A. Mohamed, and O. Mohammed, "Smart Optimal Control of DC-DC Boost Converter in PV Systems" *IEEE Transmission and Distribution Conference and Exposition Latin America*, 2010, pp. 978-1-4577-0487-1/10.
- [20] Bibhu Prasad Ganthia, R. Dharmaprasadh, Tushar Choudhary, T. Vijay Muni, Essam A. Al-Ammar, A. H. Seikh, M. H. Siddique, Abdi Diriba, "Simulation Model of PV System Function in Stand-Alone Mode for Grid Blackout Area", *International Journal of Photoenergy*, vol. 2022, Article ID 6202802, 12 pages, 2022. <https://doi.org/10.1155/2022/6202802>
- [21] Ravi Kishore, D., Chandra Sekhar, G., Prakash, R. B. R., & Vijay Muni, T. (2020). A novel power management scheme for distributed generators in a DC microgrid IOP: Conference series. In *IOP Conference Series: Materials Science and Engineering* (Vol. 993). IOP Publishing Ltd. <https://doi.org/10.1088/1757-899X/993/1/012083>
- [22] Zulkifile Ibrahim, "Performance investigation of photovoltaic grid connection for shunt active power filter with different PWM generation" 20th November 2013. Vol. 57 No.2.
- [23] Ahmed M. Atallah, "Implementation of perturb and Observe MPPT of PV system with direct Control method using buck and buck-boost Converters *Emerging Trends in Electrical*", *Electronics & Instrumentation Engineering: An International Journal (EEIEJ)*, Vol. 1, No. 1, February 2014.
- [24] Ayman Blorfan, Patrice Wira, "A three-phase hybrid active power filter With photovoltaic generation and Hysteresis current control" 2011 IEEE.
- [25] T. Chaitanya, "Modeling and Simulation of PV Array and its Performance Enhancement Using MPPT (P&O) Technique" *International Journal of Computer Science & Communication Networks*, Vol 1(1), September-October 2011.
- [26] Thomas Geury, "Three-phase Power Controlled PV Current Source Inverter with Incorporated Active Power Filtering", 2013 IEEE.
- [27] Remya A.V., "Grid interconnection of PV system for 3 phase 4 wire Distribution system with power-quality improvement" *International Conf. on Electrical, Electronics, Mechanical & Computer Engineering*, 06th July-2014, Cochin, India.
- [28] Vijay Muni, T., Srikanth, K. S., Venkatesh, N., & Sumedha, K. L. (2018). A high performance hybrid MPPT control scheme for a grid connected PV system based three level NPCMLI. *International Journal of Engineering and Technology (UAE)*, 7(2), 37-40. <https://doi.org/10.14419/ijet.v7i2.20.11741>
- [29] Muni, T. V., & Lalitha, S. V. N. L. (2020). Implementation of control strategies for optimum utilization of solar photovoltaic systems with energy storage systems. *International Journal of Renewable Energy Research*, 10(2), 716-726.
- [30] Muni, T. V., Kishore, K. V., & Reddy, N. S. (2014). Voltage flicker mitigation by FACTS devices. In *2014 International Conference on Circuits, Power and Computing Technologies, ICCPCT 2014* (pp. 656-661). Institute of Electrical and Electronics Engineers Inc. <https://doi.org/10.1109/ICCPCT.2014.7054898>
- [31] Shabnam, P., Priyanka, A. K., Vijay Muni, T., & Rajasekhar, S. (2020). PID controller based grid connected wind turbine energy system for power quality improvement. *Journal of Critical Reviews*, 7(7), 31-35. <https://doi.org/10.31838/jcr.07.07.06>
- [32] Moulali, S., Vijay Muni, T., Bala Subrahmanyam, Y., & Kesav, S. (2018). A flying capacitor multilevel topology for pv system with apod and pod pulse width modulation. *Journal of Advanced Research in Dynamical and Control Systems*, 10(2), 96-101.
- [33] Harshith, I., Raj, B. P., Raja Sekhar, G. G., & Muni, T. V. (2019). A novel methodology for single phase transformerless inverter with leakage current elimination for pv systems application. *International Journal of Innovative Technology and Exploring Engineering*, 8(6), 1017-1021.
- [34] Mounika Muppavarapu, G G Rajasekhar, T Vijay Muni, R B R Prakash. ENHANCEMENT OF POWER QUALITY IN A GRID CONNECTED UDE BASED PV INVERTER. *JCR*. 2020; 7(2): 340-343. doi:10.31838/jcr.07.02.65
- [35] Bhargavi, R., Ganesh, P., Raja Sekhar, G. G., Prakash, R. B. R., & Muni, T. V. (2020). Design and implementation of novel multilevel inverter. *Journal of Advanced Research in Dynamical and Control Systems*, 12(2), 1322-1328. <https://doi.org/10.5373/JARDCS/V12I2/S20201169>
- [36] J. Rodriguez, J.-S. Lai, and F. Z. Peng, "Multilevel inverters: A survey of topologies, controls, and applications," *IEEE Trans. Ind. Electron.*, vol. 49, no. 4, pp. 724-738, Aug. 2002.
- [37] Baig, K., Prudhvi Raj, K., Raja Sekhar, G. G., Vijay Muni, T., & Kiran Kumar, M. (2020). Power quality enhancement with active power control. *Journal of Critical Reviews*, 7(9), 739-741. <https://doi.org/10.31838/jcr.07.09.143>
- [38] Ravi Kishore, D., Vijay Muni, T., & Srikanth, K. S. (2020). A novel power electronic-based maximum power point tracking technique for solar pv applications. In *Lecture Notes in Electrical Engineering* (Vol. 687, pp. 115-126). Springer Science and Business Media Deutschland GmbH. https://doi.org/10.1007/978-981-15-7245-6_10
- [39] Rachid Belaidi, "Shunt active power filter connected to a photovoltaic array for compensating harmonics and reactive

power simultaneously" 4th International Conference on Power Engineering, Energy and Electrical Drives Istanbul, 13-17 May 2013 IEEE, Turkey.

- [40] A.S. Abu Hasim, "Photovoltaic System Connected to Three Phase Grid Connected System Incorporating With Active Power Filter" Australian Journal of Basic and Applied Sciences, 345-353, 2012 ISSN 1991-8178.
- [41] Jeevananthan K.S, "Designing of Single Phase Shunt Active Filter Using Instantaneous Power Theory" International Journal of Electrical and Electronics Research Vol. 2, Issue 2, pp: (1-10), Month: April - June 2014.

