



Power Management Strategy for Grid Connected Hybrid System in Islanded Microgrid using Adaptive Droop Control

V.Sudhakar¹, S.Praveen²

¹Assistant Professor, Dept of EEE, Avanthi Institute of Engineering & Technology, Vijayanagaram

²PG Student, Dept of EEE, Avanthi Institute of Engineering & Technology, Vijayanagaram

To Cite this Article

V.Sudhakar and S.Praveen. Power Management Strategy for Grid Connected Hybrid System in Islanded Microgrid using Adaptive Droop Control. *International Journal for Modern Trends in Science and Technology* 2021, 7 pp. 141-146. <https://doi.org/10.46501/IJMTST0709022>

Article Info

Received: 13 August 2021; Accepted: 11 September 2021; Published: 15 September 2021

ABSTRACT

This paper proposes concept for energy management for grid connected hybrid system under islanding condition. Power management Control strategy used in this paper enables photovoltaic/battery unit as a primary supply that employs an adaptational droop control to share the load with alternative sources whereas charging the battery. And additionally this control technique is intended to switch the PV in operation to match the load demand autonomously whenever the available PV power is beyond the load and also the battery is totally charged. In addition with under islanding microgrid conditions, such as voltage and frequency regulation and also under any power deficit circumstances the battery provide operational functions with a separate storage unit.

KEYWORDS— State of Charge, Droop, PV system, Micro-grid.

INTRODUCTION

PV array systems are thought of to be a gorgeous possibility among all non-conventional energy sources in distribution system, increasing potency, high responsibility, and low maintenance. From operation point of view, PV systems are classified as either complete or grid interfaced. Generally, in microgrid systems the PV systems as behaves as a controlled current sources in order to inject suitable PV power to microgrid. In this paper the techniques for effective energy management is applied for microgrid under islanded condition. These methods need that the effective power management system has access to the ability measurements at each decigram unit and cargo

node. Therefore, all load nodes and native hundreds should be equipped with power activity and communication modules, that don't seem to be sensible or promptly out there in most standard distribution networks. Additionally, consistent with the rule projected in, the battery and the electric cell are accustomed share the deficit load exploitation droop control when the ability equipped from the PV and also the small rotary engine is shy. This might exhaust the battery storage that is that the most important component under microgrid islanding conditions, and will lead to motion down the microgrid.

Configuration of Power Management strategy:

Figure 1 shows the simplified schematic diagram for an islanded based micro-grid system. Metric weight unit one could be a standard droop controlled unit, and metric weight unit a pair of Solar System/battery hybrid unit into account. This paper proposed an operational functions and utilization of PV system for microgrid applications. Sodium molecule and P_{Bo} represent the power supplied from the battery storage system. The dc-link interfaced battery is used in this system and its controlled with bi-directional converter for both charging and discharging

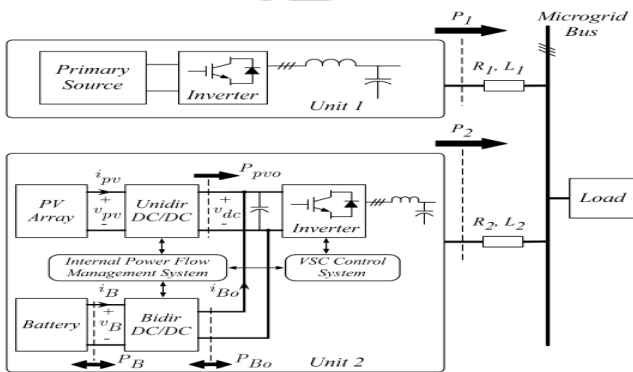


Fig 1: Architecture of Proposed System

The control strategy for effective power management scheme is explained based on the figure shown in 2. In this the controller MPPT is used for controlling PV power with the help of latching signal from SOC of battery. And second controller in figure 2 is used for controlling battery power. If the SOC is minimum then MPPT controller is enabled so that it can be controlled with help of MPPT. In other way the reference voltage for PV controller is obtained directly from SOC controller if MPPT is disabled by latching signal from SOC controller.

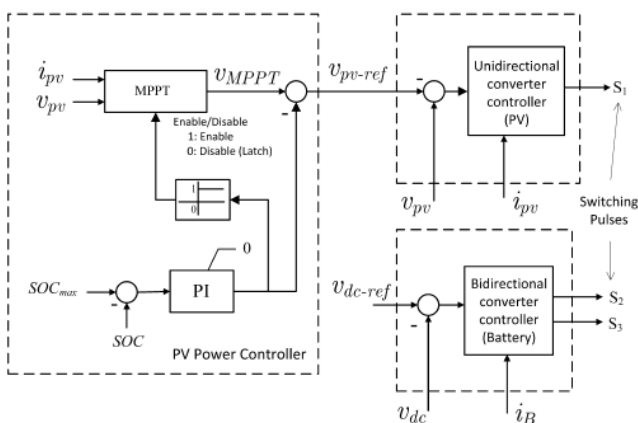


Fig 2: Structure for Droop Control

Photovoltaic System:

Operation of Photovoltaic system is to convert solar energy to electrical energy. Generally, solar panel is form of array structure. In this every cell is comparable to a diode with a tangency shaped. It produces current once lightweight absorbed at the junction, by PV system. Figure 4 shows the PV and IV characteristics of solar panel. And figure 3 shows the electrical equivalent circuit for PV system which is used solar energy (i.e current) to electrical energy.

$$I = I_{ph} - I_D - I_{sh}$$

$$I = I_{ph} - I_0 [\exp (q V_D / nKT)] - (V_D / R_s)$$

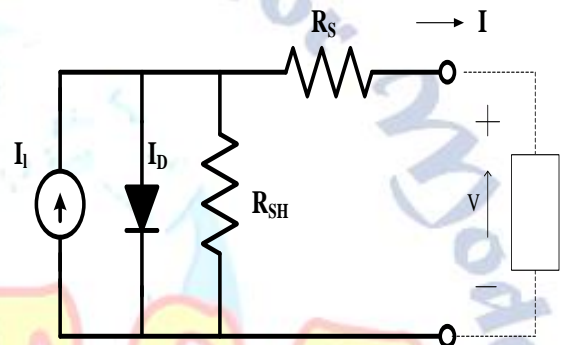


Figure 3: Electrical circuit of PV Module

The output power from the PV cell is expressed as $P=VI$

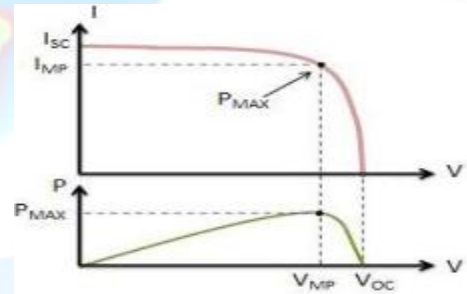


Figure 4: P-V & I-V Curves for Solar Panel

Figure 5 shows the Solar panel I-V characteristics with constant temperature and irradiance.

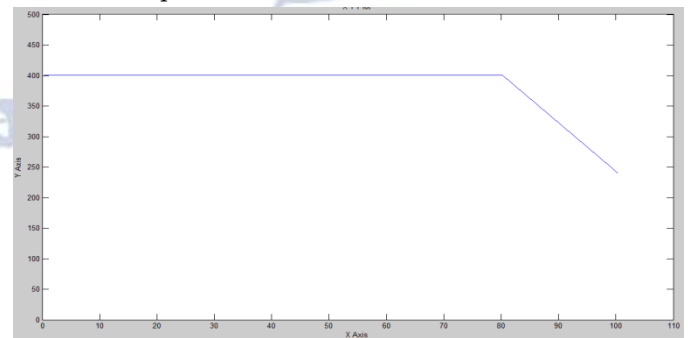


Fig 5: I-V Characteristics of Solar System

Figure 6 shows the characteristics of solar panel between Voltage and Power under different irradiance.

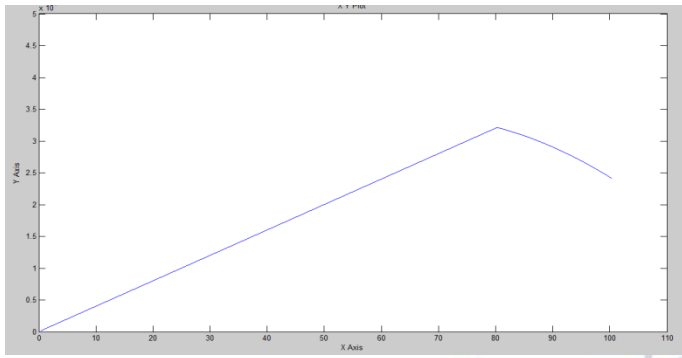


Fig 6: P-V Characteristics of Solar System

BATTERY ENERGY STORAGE SYSTEM:

The change of AC to DC is finished by Battery energy system, generally it's based on power electronic converters. Here the working of battery i.e. transformation of power into energy for putting away reason. By utilizing DC power Batteries may charges and in some cases releases. For this purpose Bi-directional power electronic converters are required for controlling power flow from batteries to energy systems and vice-versa. In view of assortment of battery it's having fluctuated benefits and bad marks like value, weight, size, and power and vitality capacity.

VSC CONTROL SYSTEM:

Figure 7 shows the control diagram for voltage source converter which is used for generating voltage and frequency reference signals. The power from the hybrid system is converted to ω with the help of adaptive droop controller as shown in figure 8. The effect of harmonics in power can be eliminated using first order filter.

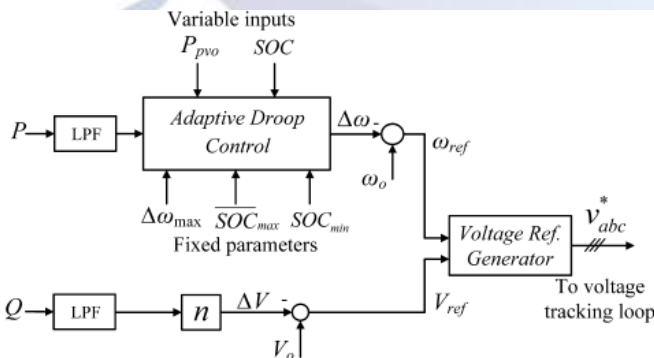


Fig 7: Droop control technique

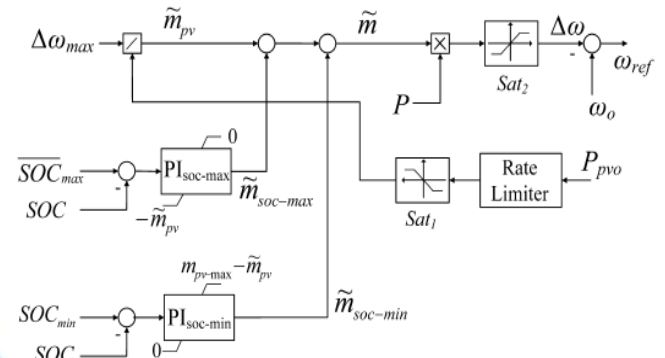


Fig 8: Control Diagram

Figure 7 shows the control structure which is used for implementation of operational scenario of adaptive droop control. In this, the slope of middle section is represented with 'm' in this droop curves. From figure 8, the slope 'm' is derived by considering the 3 slope variables such as m_{pv} , $m_{soc-max}$, and $m_{soc-min}$. As from the Fig. 8, the saturation limits for two PI controllers are $PI_{soc-max}$ and $PI_{soc-min}$ area unit is considered such that remain idle, i.e., each $m_{soc-max}$ and $m_{soc-min}$ equal zero, once $SOC_{min} \leq SOC \leq SOC_{max}$.

Power Sharing Scenario;

Figure 9 shows the graphical representation between powers from the PV system to frequency which is called power sharing techniques. In this the minimum slope limits PV_{min} is taken by PV array power ratings and while the slope m_{pvmax} is chosen from 2 controller. Suppose for example, the m_{pvmax} is calculated for 25% of PV power, therefore the battery can offer only 1/4th of solar power once all other units reach their rated limits.

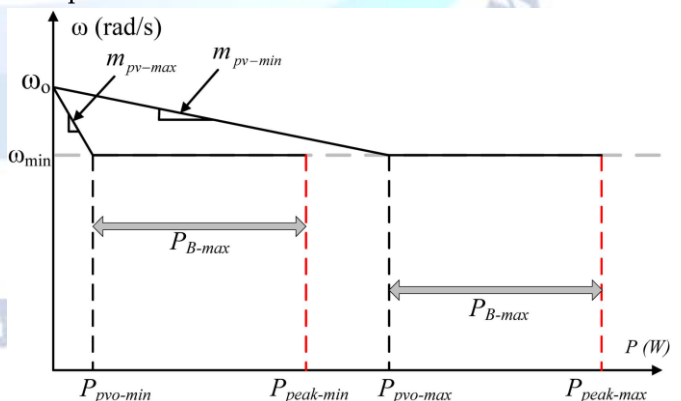


Fig 9: Droop Characteristics

EXPERIMENTAL SETUP AND RESULTS:

The performance of the grid interfaced hybrid system as shown in figure 1 is observed in Matlab/Simulink. It consist of PV structure, battery and

also a VSI inverter which is used for grid interface purpose. The simulation results for this system is shown in two cases such as,

Case 1: Power Sharing & Balancing Scenario

Figure 10 shows the results for hybrid system during power sharing scenario. In this result we observed that the power shares from unit 1 to unit 2. And the change droop slope according power transfer rate limiter is shown in figure 11 and figure 12.

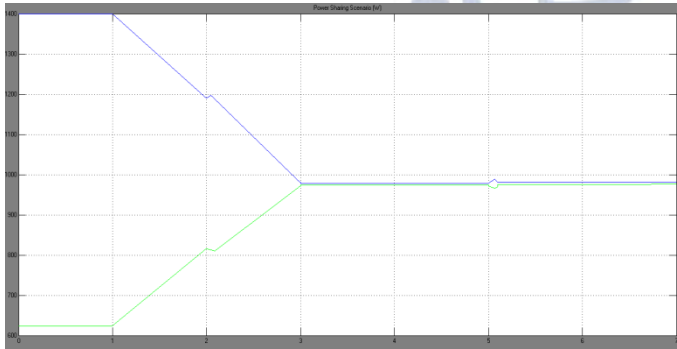


Fig 10: Result for performance of Hybrid System during Power Sharing Strategy

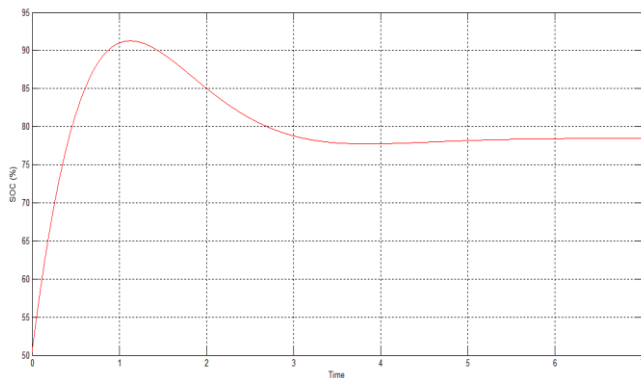


Fig 11: Simulation Result State of Charge

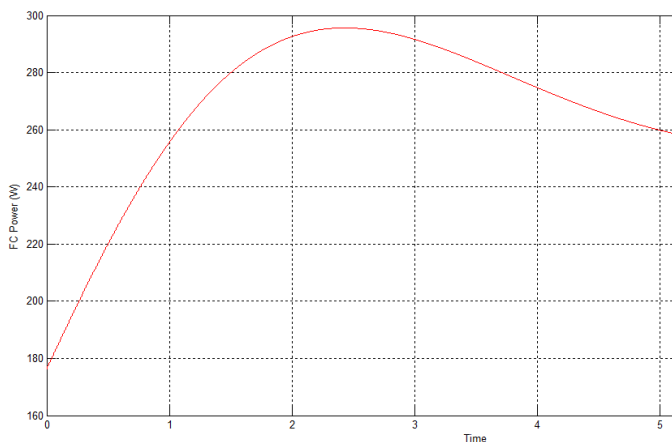


Fig 12: Simulation Result for Battery Power

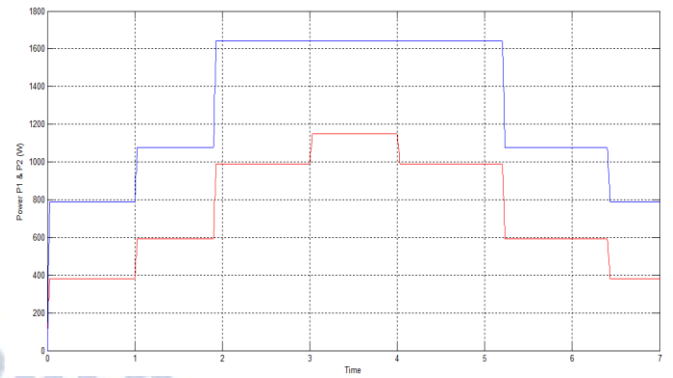


Fig 13: Result for performance of hybrid system under Power Balancing Condition

The result in Fig. 13 shows that the power balancing conditions between Bus1 and Bus2.

Case 2: Experimental verification under SOC Upper Control limit

The performance results of the proposed grid interfaced hybrid system under SOC upper limit control is shown in figure 14 - 16. In this figure 14 shows the simulation results for power which is generated from PV and Battery system. Figure 15 shows the simulation results for power across bus 1 and bus2 and figure 16 shows the state of charge characteristics for battery under these considerations.

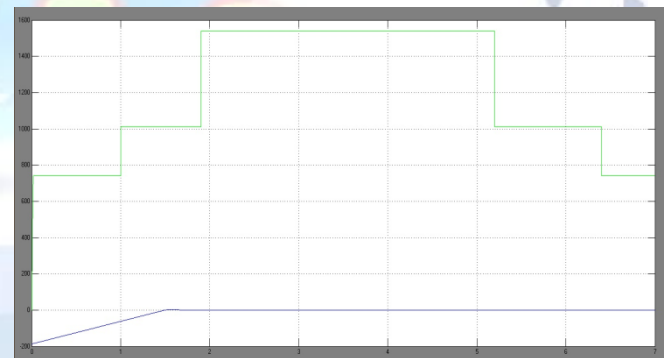


Fig 14: Simulation result for PV and Battery Powers under External SOC Controller

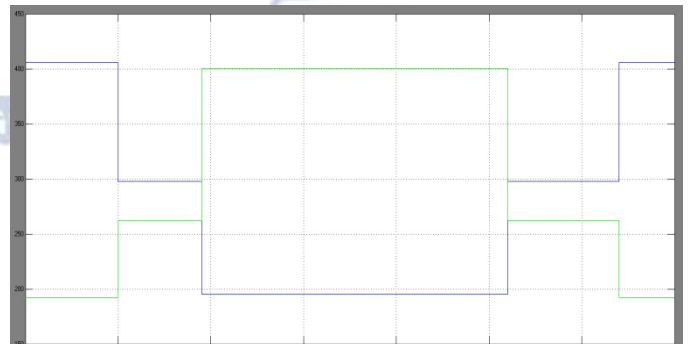


Fig 15: Simulation result for Bus1 & Bus 2 Power at load under External SOC Controller

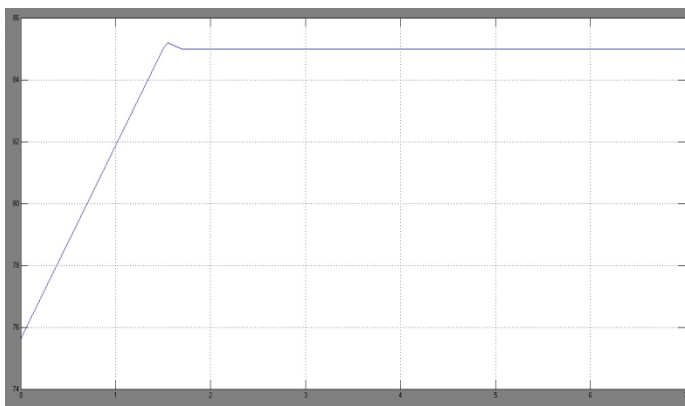


Fig 16: Simulation result for Battery State of charge under External SOC Controller

The performance of the proposed grid interfaced microgrid under the condition of SOC reaches its maximum value. Figure 17-19 shows the simulation results for hybrid system. Figure 17 is output result for power across battery and PV system. Figure 18 is output result for power which is flows through load from bus 1 to bus 2. And figure 19 is battery state of charge conditions.



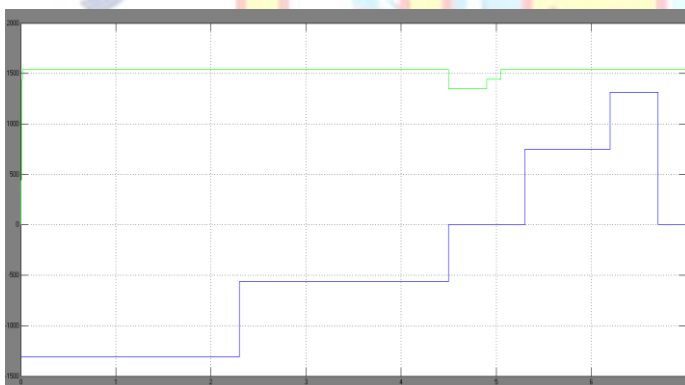


Fig 17: Simulation result for PV and Battery Powers under External SOC Controller

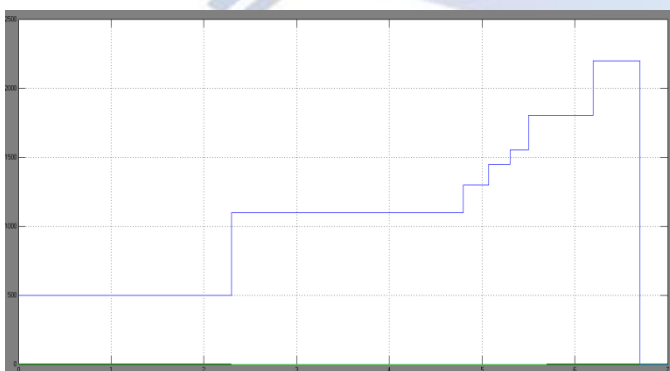

(a)

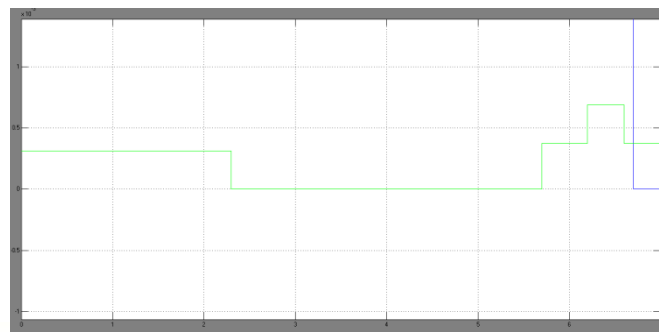

(b)

Fig 18 (a) & (b): Simulation result for Bus1 & Bus 2 Power at load under External SOC Controller

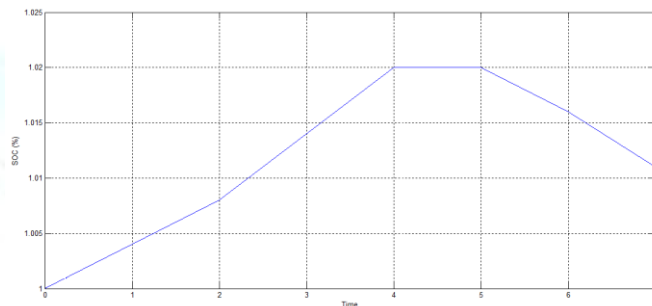


Fig 19: Simulation result for Battery State of charge under External SOC Controller

Case 3: Battery Charging Priority Scenario

Figure 20-22 shows the performance result for hybrid system under battery charging priority.

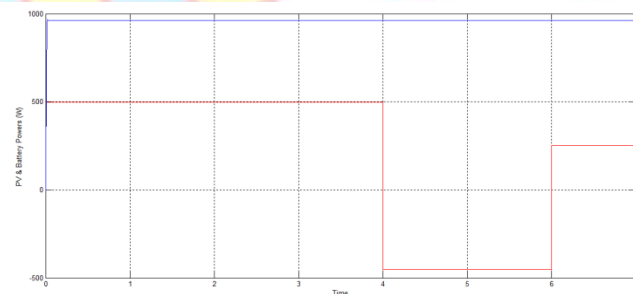


Fig 20 : Simulation Result for PV & Battery Power

Figure 20 shows the simulation result for PV and battery powers during battery charging priority. In this case the Power from the solar power is maintained constant and observe the charging performance of battery.

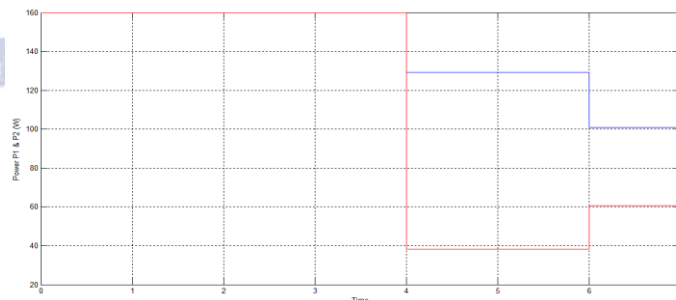


Fig 21: Simulation Result for Load Power under Bus 1 & Bus2

Figure 21 shows the simulation result for Powers under bus 1 & bus 2 at load terminals. And figure 22 shows the result of state of charge for battery.

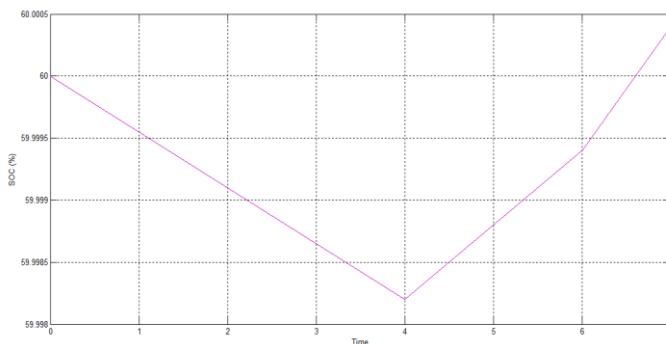


Fig 22: Simulation Result for State of Charge

CONCLUSION:

This paper gives conclusion about effective power management control strategy using adaptive droop control technique. In this paper PV/battery unit is controlled using adaptive droop control to work as voltage supply, in contrast to the control strategy used in photovoltaic system from the literature wherever the Solar units are controlled to work as current controlled sources. Generally, in this system first the hybrid unit delivers power to load and stores in battery if there is any excess power generation. And consequently, in the second case, it will track and supply the most PV power to the microgrid provided that there's any deficit in load at microgrid. On third case, the control strategy changes the operating scenario of PV power to follow the load once and in any case the load which is used at microgrid is less than available solar power at that case the battery starts charging, while in other situation the battery discharges its energy if the available PV power is less than load demand. The performance of system is observed in Matlab/Simulink and also verified the result.

REFERENCES

- [1] N. Asano and T. Saga, "PV technology trends and industry's role," in Proc. IEEE Int. Electron Devices Meeting (IEDM), Dec. 2008, pp. 1-6.
- [2] G. P. Willeke, "Progress in industrial crystalline silicon solar PV technology," in Proc. IEEE 33rd Photovoltaic Specialists Conf., May 2008, pp. 1-4.
- [3] J. A. P. Lopes, C. L. Moreira, and A. G. Madureira, "Defining control strategies for microgrids islanded operation," IEEE Trans. Power Syst., vol. 21, no. 2, pp. 439-449, May 2006.
- [4] Krishna Mohan Tatikonda, Chengzong Pang, S. V. P. K. Maddukuri and R. Uday Kishan, " Comparison of MPPT Techniques for SEPIC Converter Based Photovoltaic System," 2016 IEEE Online International Conference on Green Engineering and Technologies (IC-GET), 978-1-5090-4556-3/16/\$31.00 ©2016 IEEE.
- [5] F. Ongaro, S. Saggini, and P. Mattavelli, "Li-ion battery-supercapacitor hybrid storage system for a long lifetime, photovoltaic-based wireless sensor network," IEEE Trans. Power Syst., vol. 27, no. 9, pp. 3944-3952, Sep. 2012.
- [6] H. Mahmood, D. Michaelson, and J. Jiang, "Control strategy for a standalone PV/battery hybrid system," in Proc. IEEE Ind. Electron. Conf., Oct. 2012, pp. 3412-3418.
- [7] T. Eswara Rao, Krishna Mohan Tatikonda, S. Elango, and J. Charan Kumar, "MICROGRID TECHNOLOGIES", Edited by C. Sharmeela, P. Sivaraman, P. Sanjeevi kumar, and Jens Bo Holm-Nielsen, Scrivener Publishing, ISBN: 9781119710790.
- [8] W. A. Omran, M. Kazerani, and M. M. A. Salama, "Investigation of methods for reduction of power fluctuations generated from large gridconnected photovoltaic systems," IEEE Trans. Energy Convers., vol. 26, no. 1, pp. 318-327, Mar. 2011.
- [9] S. Teleke, M. E. Baran, S. Bhattacharya, and A. Q. Huang, "Rule-based control of battery energy storage for dispatching intermittent renewable sources," IEEE Trans. Sustainable Energy, vol. 1, no. 3, pp. 117-124, Oct. 2010.
- [10] Krishna Mohan Tatikonda, Udaya K. Renduchintala, Chengzong Pang, and Lin Yang, " ANFIS-fuzzy logic based UPQC in interconnected microgrid distribution systems: Modeling, simulation and implementation," 2021 The Authors. The Journal of Engineering published by John Wiley & Sons Ltd on behalf of The Institution of Engineering and Technology, <https://doi.org/10.1049/tje2.12005>.
- [11] H. Beltran, E. Bilbao, E. Belenguer, I. Etxeberria-Otadui, and P. Rodriguez, "Evaluation of storage energy requirements for constant production in PV power plants," IEEE Trans. Ind. Electron., vol. 60, no. 3, pp. 1225-1234, Mar. 2013.
- [12] H. Fakham, D. Lu, and B. Francois, "Power control design of a battery charger in a hybrid active PV generator for load-following applications," IEEE Trans. Ind. Electron., vol. 58, no. 1, pp. 85-94, Jan. 2011.
- [13] N. Kakimoto, H. Satoh, S. Takayama, and K. Nakamura, "Ramp-rate control of photovoltaic generator with electric double-layer capacitor," IEEE Trans. Energy Convers., vol. 24, no. 2, pp. 465-473, Jun. 2009.
- [14] C. T. Rodríguez, D. V. de la Fuente, G. Garcerá, E. Figueres, and J. A. G. Moreno, "Reconfigurable control scheme for a PV microinverter working in both grid-connected and island modes," IEEE Trans. Ind. Electron., vol. 60, no. 4, pp. 1582-1595, Apr. 2013.
- [15] B. I. Rani, G. S. Ilango, and C. Nagamani, "Control strategy for power flow management in a PV system supplying DC loads," IEEE Trans. Ind. Electron., vol. 60, no. 8, pp. 3185-3194, Aug. 2013.